

Air Conditioning
Technical Data

RZAG-MV1



TABLE OF CONTENTS

RZAG-MV1

| | | |
|----|--|----|
| 1 | Features | 2 |
| 2 | Specifications | 3 |
| | Capacity and Power input | 3 |
| | Capacity and Power input | 3 |
| | Capacity and Power input | 3 |
| | Capacity and Power input | 4 |
| | Capacity and Power input | 4 |
| | Capacity and Power input | 5 |
| | Capacity and Power input | 5 |
| | Technical Specifications | 5 |
| | Electrical Specifications | 7 |
| 3 | Electrical data | 8 |
| 4 | Options | 11 |
| 5 | Combination table | 12 |
| 6 | Capacity tables | 13 |
| | Cooling/Heating Capacity Tables | 13 |
| 7 | Dimensional drawings | 15 |
| 8 | Centre of gravity | 16 |
| 9 | Piping diagrams | 18 |
| | Piping Diagrams | 18 |
| | Piping Diagram Twin Application | 19 |
| | Piping Diagram Triple Application | 20 |
| | Piping Diagram Double Twin Application | 21 |
| 10 | Wiring diagrams | 22 |
| | Wiring Diagrams - Single Phase | 22 |
| 11 | Sound data | 23 |
| | Sound Power Spectrum | 23 |
| | Sound Pressure Spectrum - Cooling | 25 |
| | Sound Pressure Spectrum - Heating | 27 |
| | Sound Pressure Spectrum Quiet Mode | 29 |
| 12 | Installation | 30 |
| | Installation Method | 30 |
| 13 | Operation range | 32 |

1 Features

Industry leading technology for commercial applications and even for technical rooms

- Top efficiency: - Energy labels up to A++ in both cooling and heating - compressor offers substantial efficiency improvements
- Choosing for an R-32 product, reduces the environmental impact with 68% compared to R-410A, leads directly to lower energy consumption thanks to its high energy efficiency and has a lower refrigerant charge
- The perfect balance in efficiency and comfort thanks to Variable Refrigerant Temperature: top seasonal efficiency throughout most of the year and quick reaction speed on the hottest days.
- Suits high sensible, infrastructure cooling applications
- Replace existing systems with R-32 technology without needing to replace the piping
- Guarantees operation in both heating and cooling mode down to -20°C
- Refrigerant cooled PCB guarantees reliable cooling, as it is not influenced by ambient temperature.
- Maximum piping length up to 85m
- Outdoor units for pair, twin, triple, double twin application



Infrastructure cooling



Inverter



Auto cooling-heating changeover

2 Specifications

| 2-1 Capacity and Power input | | | FBA71A/ RZAG71MV1 | FBA100A/ RZAG71MV1 | FBA100A/ RZAG100MV1 | FBA140A/ RZAG100MV1 | FBA125A/ RZAG125MV1 | FBA140A/ RZAG140MV1 | | |
|--|------------------------------|---------------------------|----------------------|-----------------------|------------------------|------------------------|------------------------|------------------------|-------|--|
| Indoor unit | | | FBA71A2VEB | FBA100A2VEB | | FBA140A2VE B | FBA125A2VE B | FBA140A2VE B | | |
| Outdoor unit | | | RZAG71M7V1B | | RZAG100M7V1B | | RZAG125M7V 1B | RZAG140M7V 1B | | |
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | | 12.1 (1) | 13.4 (1) | | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | | 13.5 (2) | 15.5 (2) | | |
| Seasonal efficiency (according to EN14825) | Cooling | Energy efficiency class | A++ | A+ | A++ | | - | | | |
| | | Pdesign | kW | | 6.80 | | 9.50 | 12.1 | 13.4 | |
| | | SEER | 6.22 | 5.81 | 6.47 | 6.39 | 6.19 | 6.42 | | |
| | | Annual energy consumption | kWh | 382 | 410 | 514 | 520 | 1,173 | 1,252 | |
| | Heating (Average climate) | Energy efficiency class | A+ | | | | | - | | |
| | | Pdesign | kW | | 4.70 | | 7.80 | | 9.52 | |
| | | SCOP/A | 4.20 | 4.06 | 4.36 | 4.20 | 4.12 | 4.11 | | |
| | | Annual energy consumption | kWh | 1,566 | 1,621 | 2,505 | 2,600 | 3,235 | 3,243 | |

Notes

(1) Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

| 2-2 Capacity and Power input | | | FCAHG100G/ RZAG71MV1 | FCAHG71G/ RZAG71MV1 | FCAHG140G/ RZAG100MV1 | FCAHG100G/ RZAG100MV1 | FCAHG125G/ RZAG125MV1 | FCAHG140G/ RZAG140MV1 | |
|--|------------------------------|---------------------------|-------------------------|------------------------|--------------------------|--------------------------|--------------------------|--------------------------|-------|
| Indoor unit | | | FCAHG100GV EB | FCAHG71GV EB | FCAHG140GV EB | FCAHG100GV EB | FCAHG125GV EB | FCAHG140GV EB | |
| Outdoor unit | | | RZAG71M7V1B | | RZAG100M7V1B | | RZAG125M7V 1B | RZAG140M7V 1B | |
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | | 12.1 (1) | 13.4 (1) | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | | 13.5 (2) | 15.5 (2) | |
| Seasonal efficiency (according to EN14825) | Cooling | Energy efficiency class | A++ | | | | | - | |
| | | Pdesign | kW | | 6.80 | | 9.50 | 12.1 | 13.4 |
| | | SEER | 7.05 | 7.72 | 7.93 | 7.35 | 8.02 | 7.93 | |
| | | Annual energy consumption | kWh | 338 | 308 | 419 | 452 | 905 | 1,014 |
| | Heating (Average climate) | Energy efficiency class | A+ | A++ | | | - | | |
| | | Pdesign | kW | | 4.70 | | 9.52 | | |
| | | SCOP/A | 4.20 | 4.61 | 4.70 | 4.81 | 4.53 | 4.44 | |
| | | Annual energy consumption | kWh | 1,567 | 1,427 | 2,836 | 2,771 | 2,942 | 3,002 |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

| 2-3 Capacity and Power input | | | FCAG100A/ RZAG71MV1 | FCAG71A/ RZAG71MV1 | FCAG140A/ RZAG100MV1 | FCAG100A/ RZAG100MV1 | FCAG125A/ RZAG125MV1 | FCAG140A/ RZAG140MV1 |
|------------------------------|------|----|------------------------|-----------------------|-------------------------|-------------------------|-------------------------|-------------------------|
| Indoor unit | | | FCAG100AVE B | FCAG71AVEB | FCAG140AVE B | FCAG100AVE B | FCAG125AVE B | FCAG140AVE B |
| Outdoor unit | | | RZAG71M7V1B | | RZAG100M7V1B | | RZAG125M7V 1B | RZAG140M7V 1B |
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | | 12.1 (1) | 13.4 (1) |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | | 13.5 (2) | 15.5 (2) |

2 Specifications

2

| 2-3 Capacity and Power input | | | FCAG100A/ RZAG71MV1 | FCAG71A/ RZAG71MV1 | FCAG140A/ RZAG100MV1 | FCAG100A/ RZAG100MV1 | FCAG125A/ RZAG125MV1 | FCAG140A/ RZAG140MV1 | |
|--|------------------------------|------------------------------|------------------------|-----------------------|-------------------------|-------------------------|-------------------------|-------------------------|-------|
| Seasonal efficiency (according to EN14825) | Cooling | Energy efficiency class | | A++ | | | | - | |
| | | Pdesign | kW | 6.80 | | 9.50 | | 12.1 | 13.4 |
| | | SEER | | 7.50 | 6.86 | 7.86 | 7.14 | 7.80 | 7.17 |
| | | Annual energy consumption | kWh | 317 | 347 | 423 | 466 | 931 | 1,121 |
| | Heating (Average climate) | Energy efficiency class | | A+ | | A++ | | - | |
| | | Pdesign | kW | 4.70 | | 7.80 | | 9.52 | |
| | | SCOP/A | | 4.45 | 4.41 | 4.66 | 4.61 | 4.34 | |
| | | Annual energy consumption | kWh | 1,479 | 1,492 | 2,343 | 2,369 | 3,071 | |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

| 2-4 Capacity and Power input | | | FHA100A/ RZAG71MV1 | FHA71A/ RZAG71MV1 | FHA140A/ RZAG100MV1 | FHA100A/ RZAG100MV1 | FHA125A/ RZAG125MV1 | FHA140A/ RZAG140MV1 | |
|--|------------------------------|------------------------------|-----------------------|----------------------|------------------------|------------------------|------------------------|------------------------|-------|
| Indoor unit | | | FHA100AVEB | FHA71AVEB | FHA140AVEB | FHA100AVEB | FHA125AVEB | FHA140AVEB | |
| Outdoor unit | | | RZAG71M7V1B | | RZAG100M7V1B | | RZAG125M7V 1B | RZAG140M7V 1B | |
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | | 12.1 (1) | 13.4 (1) | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | | 13.5 (2) | 15.5 (2) | |
| Seasonal efficiency (according to EN14825) | Cooling | Energy efficiency class | | A++ | | | | - | |
| | | Pdesign | kW | 6.80 | | 9.50 | | 12.1 | 13.4 |
| | | SEER | | 6.69 | 7.11 | 8.24 | 6.42 | 8.22 | 6.42 |
| | | Annual energy consumption | kWh | 356 | 335 | 404 | 518 | 883 | 1,252 |
| | Heating (Average climate) | Energy efficiency class | | A+ | | A++ | | - | |
| | | Pdesign | kW | 4.70 | | 7.80 | | 9.52 | |
| | | SCOP/A | | 4.26 | 4.32 | 4.64 | 4.61 | 4.09 | 4.30 |
| | | Annual energy consumption | kWh | 1,545 | 1,523 | 2,353 | 2,369 | 3,259 | 3,100 |

Notes

(1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

(2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

| 2-5 Capacity and Power input | | | FUA100A/RZAG71MV1 | FUA71A/RZAG71MV1 | FUA100A/RZAG100MV1 | FUA125A/RZAG125MV1 | |
|--|------------------------------|------------------------------|-------------------|------------------|--------------------|--------------------|-------|
| Indoor unit | | | FUA100AVEB | FUA71AVEB | FUA100AVEB | FUA125AVEB | |
| Outdoor unit | | | RZAG71M7V1B | | RZAG100M7V1B | RZAG125M7V1B | |
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | 12.1 (1) | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | 13.5 (2) | |
| Seasonal efficiency (according to EN14825) | Cooling | Energy efficiency class | | A++ | | | - |
| | | Pdesign | kW | 6.80 | | 9.50 | 12.1 |
| | | SEER | | 6.89 | 7.02 | 6.42 | 6.39 |
| | | Annual energy consumption | kWh | 345 | 339 | 518 | 1,136 |
| | Heating (Average climate) | Energy efficiency class | | A+ | | | - |
| | | Pdesign | kW | 4.70 | | 7.80 | 9.52 |
| | | SCOP/A | | 4.28 | 4.20 | 4.50 | 4.26 |
| | | Annual energy consumption | kWh | 1,537 | 1,567 | 2,427 | 3,129 |

4

2 Specifications

Notes

- (1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.
 (2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.
 Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

| 2-6 Capacity and Power input | | | FAA100A/RZAG71MV1 | FAA71A/RZAG71MV1 | FAA100A/RZAG100MV1 | |
|--|---------------------------|---------------------------|-------------------|------------------|--------------------|-------|
| Indoor unit | | | FAA100AUVEB | FAA71AUVEB | FAA100AUVEB | |
| Outdoor unit | | | RZAG71M7V1B | | RZAG100M7V1B | |
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | |
| Seasonal efficiency (according to EN14825) | Cooling | Energy efficiency class | | A++ | | |
| | | Pdesign | kW | 6.80 | | 9.50 |
| | | SEER | | 6.43 | 6.58 | 6.42 |
| | | Annual energy consumption | kWh | 370 | 362 | 518 |
| | Heating (Average climate) | Energy efficiency class | | A+ | | |
| | | Pdesign | kW | 4.70 | | 7.80 |
| | | SCOP/A | | 4.16 | 4.02 | 4.01 |
| | | Annual energy consumption | kWh | 1,582 | 1,637 | 2,723 |

Notes

- (1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.
 (2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.
 Cooling: T2: indoor temp. 26,6°CDB, 19,4°CWB, outdoor temp. 48°CDB [Btu/hr/W]

| 2-7 Capacity and Power input | | | FVA100A/RZAG71MV1 | FVA71A/RZAG71MV1 | FVA100A/RZAG100MV1 | FVA140A/RZAG100MV1 | FVA125A/RZAG125MV1 | FVA140A/RZAG140MV1 | |
|--|---------------------------|---------------------------|-------------------|------------------|--------------------|--------------------|--------------------|--------------------|-------|
| Indoor unit | | | FVA100AMVE B | FVA71AMVEB | FVA100AMVE B | FVA140AMVE B | FVA125AMVE B | FVA140AMVE B | |
| Outdoor unit | | | RZAG71M7V1B | | RZAG100M7V1B | | RZAG125M7V1B | RZAG140M7V1B | |
| Cooling capacity | Nom. | kW | 6.80 (1) | | 9.50 (1) | | 12.1 (1) | 13.4 (1) | |
| Heating capacity | Nom. | kW | 7.50 (2) | | 10.8 (2) | | 13.5 (2) | 15.5 (2) | |
| Seasonal efficiency (according to EN14825) | Cooling | Energy efficiency class | | A++ | | A+ | A++ | - | |
| | | Pdesign | kW | 6.80 | | 9.50 | | 12.1 | 13.4 |
| | | SEER | | 6.41 | 6.37 | 6.00 | 6.43 | 6.41 | 6.12 |
| | | Annual energy consumption | kWh | 371 | 374 | 554 | 517 | 1,133 | 1,314 |
| | Heating (Average climate) | Energy efficiency class | | A+ | | | | - | |
| | | Pdesign | kW | 4.70 | | 7.80 | | 9.52 | |
| | | SCOP/A | | 4.05 | | 4.20 | 4.05 | 4.15 | 3.94 |
| | | Annual energy consumption | kWh | 1,625 | | 2,600 | 2,697 | 3,209 | 3,383 |

Notes

- (1) Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.
 (2) Nominal heating capacities are based on: indoor temperature: 20°CDB, outdoor temperature: 7°CDB, 6°CWB, equivalent refrigerant piping: 5m, level difference: 0m.

| 2-8 Technical Specifications | | RZAG71MV1 | RZAG100MV1 | RZAG125MV1 | RZAG140MV1 |
|------------------------------|----------|--------------------------------|------------|------------|------------|
| Capacity control | Method | Inverter controlled | | | |
| Casing | Colour | Ivory white | | | |
| | Material | Painted galvanized steel plate | | | |

2 Specifications

2

| 2-8 Technical Specifications | | | | | RZAG71MV1 | RZAG100MV1 | RZAG125MV1 | RZAG140MV1 |
|------------------------------|---------------------|--------------------|-------------------------------|--------------------------------------|-----------|------------|------------|------------|
| Dimensions | Unit | Height | mm | | 990 | 1,430 | | |
| | | Width | mm | | 940 | | | |
| | | Depth | mm | | 320 | | | |
| | Packed unit | Height | mm | | 1,170 | 1,610 | | |
| | | Width | mm | | 1,015 | | | |
| | | Depth | mm | | 422 | | | |
| Weight | Unit | kg | | 70 | 92 | | | |
| | Packed unit | kg | | 79 | 102 | | | |
| Packing | Weight | kg | | 9 | 10 | | | |
| Heat exchanger | Fin | Type | WF fin | | | | | |
| | | Treatment | Anti-corrosion treatment (PE) | | | | | |
| Compressor | Quantity | | | 1 | | | | |
| | Type | | | Hermetically sealed swing compressor | | | | |
| | Starting method | | | Inverter driven | | | | |
| Fan | Type | | | Propeller | | | | |
| | Discharge direction | | | Horizontal | | | | |
| | Quantity | | | 1 | 2 | | | |
| | Air flow rate | Cooling | Nom. | m ³ /min | 59 | 70 | 83 | |
| | | Heating | Nom. | m ³ /min | 50 | 62 | | |
| Fan motor | Quantity | | | 1 | 2 | | | |
| | Model | | | Brushless DC motor | | | | |
| | Output | | | W | 94 | | | |
| | Drive | | | Direct drive | | | | |
| | Speed | Cooling | Super low | rpm | - | | | |
| | | Heating | Super low | rpm | - | | | |
| Sound power level | Cooling | | | dBA | 64 | 66 | 69 | 70 |
| | Heating | | | dBA | - | | | |
| Sound pressure level | Night quiet mode | Level 2 | dBA | 42 | 44 | | | |
| | Cooling | Nom. | dBA | 46 | 47 | 50 | 51 | |
| | Heating | Nom. | dBA | 49 | 51 | 52 | | |
| Operation range | Cooling | Ambient | Min. | °CDB | -20 | | | |
| | | | Max. | °CDB | 52 | | | |
| | Heating | Ambient | Min. | °CWB | -20 | | | |
| | | | Max. | °CWB | 18.0 | | | |
| Refrigerant | Type | | | R-32 | | | | |
| | Charge | kg | | 2.95 | 3.75 | | | |
| | | TCO _{2eq} | | 1.99 | 2.53 | | | |
| | Control | | | Expansion valve (electronic type) | | | | |
| | GWP | | | 675 | | | | |
| | Circuits | Quantity | | 1 | | | | |

2 Specifications

| 2-8 Technical Specifications | | | | RZAG71MV1 | RZAG100MV1 | RZAG125MV1 | RZAG140MV1 | |
|-------------------------------|----------------|----------|---|-------------------------|------------|------------|------------|--|
| Piping connections | Liquid | Quantity | | 1 | | | | |
| | | Type | | Flare connection | | | | |
| | | OD | mm | 9,52 | | | | |
| | Gas | Quantity | | 1 | | | | |
| | | Type | | Flare connection | | | | |
| | | OD | mm | 15.9 | | | | |
| | Drain | Quantity | | 5 | | | | |
| | | Type | | Hole | | | | |
| | | ID | mm | - | | | | |
| | | OD | mm | 26 | | | | |
| | Piping length | OU - IU | Min. | m | 3 | | | |
| | | | Max. | m | 55 | 85 | | |
| | | System | Equivalent | m | 75 | 100 | | |
| | | | Chargeless | m | 40 | | | |
| Additional refrigerant charge | | | kg/m | See installation manual | | | | |
| Level difference | IU - OU | Max. | m | 30.0 | | | | |
| | IU - IU | Max. | m | 0.5 | | | | |
| Heat insulation | | | Both liquid and gas pipes | | | | | |
| Refrigerant oil | Type | | | FW68DA | | | | |
| | Charged volume | | l | 0.90 | 1.35 | | | |
| Defrost method | | | Reversed cycle | | | | | |
| Defrost control | | | Sensor for outdoor heat exchanger temperature | | | | | |
| Safety devices | Item | 01 | High pressure switch | | | | | |
| | | 02 | Low pressure switch | | | | | |
| | | 03 | Fan driver overload protector | | | | | |
| | | 04 | Fuse | | | | | |
| | | 05 | Compressor motor thermal protector | | | | | |

Standard Accessories : Tie-wraps; Quantity : 2;

Standard Accessories : Installation manual; Quantity : 1;

Standard Accessories : Refrigerant label for F-gas regulation; Quantity : 1;

Standard Accessories : General safety precautions; Quantity : 1;

Standard Accessories : LOT10 Energy Label; Quantity : 1;

| 2-9 Electrical Specifications | | | | RZAG71MV1 | RZAG100MV1 | RZAG125MV1 | RZAG140MV1 |
|-------------------------------|----------------------------|--------|---|-----------|------------|------------|------------|
| Power supply | Name | | V1 | | | | |
| | Phase | | 1~ | | | | |
| | Frequency | Hz | 50 | | | | |
| | Voltage | V | 220-240 | | | | |
| Current - 50Hz | Maximum fuse amps (MFA) | A | 20 | 32 | | | |
| Current | Zmax | List | Complies to EN61000-3-11 | | | | |
| | Minimum Ssc value | kVa | Equipment complying with EN / IEC 61000-3-12 / (1) / See note 2 | | | | |
| Current - 60Hz | Maximum fuse amps (MFA) | A | - | | | | |
| Wiring connections | For power supply | Remark | See installation manual outdoor unit | | | | |
| | For connection with indoor | Remark | See installation manual outdoor unit | | | | |
| Power supply intake | | | See installation manual outdoor unit | | | | |

Notes

(1) European/international technical standard setting the limits for harmonic currents produced by equipment connected to public low-voltage system with input current larger than 16A and ≤ 75A per phase.

(2) Ssc: Short-circuit power

Nominal cooling capacities are based on: indoor temperature: 27°CDB, 19°CWB, outdoor temperature: 35°CDB, equivalent refrigerant piping: 5m, level difference: 0m.

3 Electrical data

3 - 1 Electrical Data

3

AZAS-MV1

AZAS-MY1

RZAG-MV1

RZAG-MY1

RZASG-MV1

RZASG-MY1

Symbols

MCA: Minimum Circuit Ampere [A]
 TOCA: Total overcurrent amps [A]
 MFA: Maximum Fuse Ampere [A]
 MSC: Maximum current of the starting compressor [A]
 RLA: Rated load amps [A]
 OFM: Outdoor fan motor
 IFM: Indoor fan motor
 FLA: Full Load Ampere [A]
 KW: Fan motor rated output [kW]

Notes

- The RLA is based on the following conditions.
 - Cooling
 - Indoor temperature 27.0°C DB / 19.0°C WB
 - Outdoor temperature 35.0°C DB
 - Heating
 - Indoor temperature 20.0°C DB
 - Outdoor temperature 7.0°C DB / 6.0°C WB
- TOCA is the total value of each overcurrent set.
- Voltage range
 - The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
- The maximum allowable voltage that is unbalanced between phases is 2%.
- MCA is the maximum input current.
 - The capacity of the MFA must be greater than that of the MCA.
 - Select the MFA according to the table.
- Select the wire size according to the MCA.
- MFA is used to select the circuit breaker and the ground fault circuit interruptor.
 - Earth leakage circuit breaker

3D110014A

RZAG-MV1

RZAG-MY1

Symbols

MCA: Minimum Circuit Ampere [A]
 TOCA: Total overcurrent amps [A]
 MFA: Maximum Fuse Ampere [A]
 MSC: Maximum current of the starting compressor [A]
 RLA: Rated load amps [A]
 OFM: Outdoor fan motor
 IFM: Indoor fan motor
 FLA: Full Load Ampere [A]
 KW: Fan motor rated output [kW]

Notes

- The RLA is based on the following conditions.
 - Cooling
 - Indoor temperature 27.0°C DB / 19.0°C WB
 - Outdoor temperature 35.0°C DB
 - Heating
 - Indoor temperature 20.0°C DB
 - Outdoor temperature 7.0°C DB / 6.0°C WB
- TOCA is the total value of each overcurrent set.
- Voltage range
 - The units are suitable for use with electrical systems in which the voltage supplied to the unit terminals is not below or above the listed range limits.
- The maximum allowable voltage that is unbalanced between phases is 2%.
- MCA is the maximum input current.
 - The capacity of the MFA must be greater than that of the MCA.
 - Select the MFA according to the table.
- Select the wire size according to the MCA.
- MFA is used to select the circuit breaker and the ground fault circuit interruptor.
 - Earth leakage circuit breaker

3D110015A

3 Electrical data

3 - 1 Electrical Data

RZAG71-100MV1

| Indoor | Outdoor | Power supply | Voltage range | | MCA | TOCA | MFA | MSC | RLA | Compressor | | OFM | | IFM | |
|-------------|-----------------|-----------------|-----------------|----------------|----------------|------|-------------|-------------|-----------|-------------|-------------|-----------|--------|-----|--|
| | | | | | | | | | | kW | FLA | kW | FLA | | |
| FCAG71GVEB | RZAG71M7V1B | 50Hz ~ 220-240V | Minimum: 198 V | Maximum: 264 V | 17.5 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.091 | 0.5 | | |
| FCAG35AVEB | x2 RZAG71M7V1B | | | | 17.6 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.044 x2 | 0.3 x2 | | |
| FCAG71AVEB | RZAG71M7V1B | | | | 17.4 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.054 | 0.4 | | |
| FFA35A2VEB | x2 RZAG71M7V1B | | | | 17.8 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.050 x2 | 0.4 x2 | | |
| FBA35A2VEB | x2 RZAG71M7V1B | | | | 18.2 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.089 x2 | 0.6 x2 | | |
| FBA71A2VEB | RZAG71M7V1B | | | | 17.6 | — | 20 | — | 15.6 | 0.094 | 0.8 | 0.070 | 0.5 | | |
| FNA35A2VEB | x2 RZAG71M7V1B | | | | 17.3 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.034 x2 | 0.3 | | |
| FUA71AUVEB | RZAG71M7V1B | | 17.9 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.046 | 0.9 | | | | |
| FAA71AUVEB | RZAG71M7V1B | | 17.4 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.048 | 0.4 | | | | |
| FVA71AMVEB | RZAG71M7V1B | | 17.6 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.117 | 0.6 | | | | |
| FDXM35F3V1B | x2 RZAG71M7V1B | | 17.6 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.034 x2 | 0.3 x2 | | | | |
| FHA35AVEB | x2 RZAG71M7V1B | | 18.2 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.060 x2 | 0.6 x2 | | | | |
| FHA71AVEB | RZAG71M7V1B | | 17.8 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.091 | 0.8 | | | | |
| FCAG100GVEB | RZAG100M7V1B | | 50Hz ~ 220-240V | Minimum: 198 V | Maximum: 264 V | 27.4 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.221 | 1.3 | |
| FCAG35AVEB | x3 RZAG100M7V1B | 26.9 | | | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.044 x3 | 0.3 x3 | | |
| FCAG50AVEB | x2 RZAG100M7V1B | 26.6 | | | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.039 x2 | 0.3 x2 | | |
| FCAG100AVEB | RZAG100M7V1B | 26.7 | | | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.117 | 0.7 | | |
| FFA35A2VEB | x3 RZAG100M7V1B | 27.2 | | | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x3 | 0.4 x3 | | |
| FFA50A2VEB | x2 RZAG100M7V1B | 26.8 | | | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x2 | 0.4 x2 | | |
| FBA35A2VEB | x3 RZAG100M7V1B | 27.9 | | | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x3 | 0.6 x3 | | |
| FBA50A2VEB | x2 RZAG100M7V1B | 27.2 | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x2 | 0.6 x2 | | | | |
| FBA100A2VEB | RZAG100M7V1B | 27.0 | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.127 | 1.0 | | | | |
| FNA35A2VEB | x3 RZAG100M7V1B | 26.9 | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.034 x3 | 0.3 x3 | | | | |
| FNA50A2VEB | x2 RZAG100M7V1B | 27.0 | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x2 | 0.5 x2 | | | | |
| FUA100AVEB | RZAG100M7V1B | 27.4 | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.106 | 1.3 | | | | |
| FAA100AVEB | RZAG100M7V1B | 26.4 | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.064 | 0.4 | | | | |
| FVA100AMVEB | RZAG100M7V1B | 27.2 | | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.238 | 1.2 | | | | |
| FDXM35F3V1B | x3 RZAG100M7V1B | 26.9 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.034 x3 | 0.3 x3 | | | | | |
| FDXM50F3V1B | x2 RZAG100M7V1B | 27.0 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x2 | 0.5 x2 | | | | | |
| FHA35AVEB | x3 RZAG100M7V1B | 27.9 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.6 x3 | | | | | |
| FHA50AVEB | x2 RZAG100M7V1B | 27.2 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x2 | 0.6 x2 | | | | | |
| FHA100AVEB | RZAG100M7V1B | 27.4 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.150 | 1.3 | | | | | |

3D110014A

RZAG71-100MV1

| Indoor | Outdoor | Power supply | Voltage range | | MCA | TOCA | MFA | MSC | RLA | Compressor | | OFM | | IFM | |
|-------------|-----------------|-----------------|----------------|----------------|------|------|-------------|-------------|-----------|-------------|-----------|----------|--------|-----|--|
| | | | | | | | | | | kW | FLA | kW | FLA | | |
| FCAG100GVEB | RZAG71M7V1B | 50Hz ~ 220-240V | Minimum: 198 V | Maximum: 264 V | 18.3 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.221 | 1.3 | | |
| FCAG35AVEB | x3 RZAG71M7V1B | | | | 17.9 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.044 x3 | 0.3 x3 | | |
| FCAG50AVEB | x2 RZAG71M7V1B | | | | 17.6 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.039 x2 | 0.3 x2 | | |
| FCAG100AVEB | RZAG71M7V1B | | | | 17.7 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.117 | 0.7 | | |
| FFA35A2VEB | x3 RZAG71M7V1B | | | | 18.2 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.050 x3 | 0.4 x3 | | |
| FFA50A2VEB | x2 RZAG71M7V1B | | | | 17.8 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.050 x2 | 0.4 x2 | | |
| FBA35A2VEB | x3 RZAG71M7V1B | | | | 18.8 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.089 x3 | 0.6 x3 | | |
| FBA50A2VEB | x2 RZAG71M7V1B | | 18.2 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.089 x2 | 0.6 x2 | | | | |
| FBA100A2VEB | RZAG71M7V1B | | 18.0 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.127 | 1.0 | | | | |
| FUA100AVEB | RZAG71M7V1B | | 18.3 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.106 | 1.3 | | | | |
| FAA100AVEB | RZAG71M7V1B | | 17.4 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.064 | 0.4 | | | | |
| FVA100AMVEB | RZAG71M7V1B | | 18.2 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.238 | 1.2 | | | | |
| FDXM35F3V1B | x3 RZAG71M7V1B | | 17.9 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.034 x3 | 0.3 x3 | | | | |
| FDXM50F3V1B | x2 RZAG71M7V1B | | 18.0 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.060 x2 | 0.5 x2 | | | | |
| FHA35AVEB | x3 RZAG71M7V1B | 18.8 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.060 x3 | 0.6 x3 | | | | | |
| FHA50AVEB | x2 RZAG71M7V1B | 18.2 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.060 x2 | 0.6 x2 | | | | | |
| FHA100AVEB | RZAG71M7V1B | 18.3 | — | 20 | — | 15.5 | 0.094 | 0.8 | 0.150 | 1.3 | | | | | |
| FCAG71GVEB | x2 RZAG100M7V1B | 50Hz ~ 220-240V | Minimum: 198 V | Maximum: 264 V | 27.0 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.091 x2 | 0.5 x2 | | |
| FCAG140GVEB | RZAG100M7V1B | | | | 27.5 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.244 | 1.4 | | |
| FCAG35AVEB | x4 RZAG100M7V1B | | | | 27.2 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.044 x4 | 0.3 x4 | | |
| FCAG50AVEB | x3 RZAG100M7V1B | | | | 26.9 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.039 x3 | 0.3 x3 | | |
| FCAG71AVEB | x2 RZAG100M7V1B | | | | 26.8 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.054 x2 | 0.4 x2 | | |
| FCAG140AVEB | RZAG100M7V1B | | | | 27.0 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.168 | 1.0 | | |
| FFA35A2VEB | x4 RZAG100M7V1B | | | | 27.7 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x4 | 0.4 x4 | | |
| FFA50A2VEB | x3 RZAG100M7V1B | | 27.2 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x3 | 0.4 x3 | | | | |
| FBA35A2VEB | x4 RZAG100M7V1B | | 28.5 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x4 | 0.6 x4 | | | | |
| FBA50A2VEB | x3 RZAG100M7V1B | | 27.9 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x3 | 0.6 x3 | | | | |
| FBA71A2VEB | x2 RZAG100M7V1B | | 27.0 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.07 x2 | 0.5 x2 | | | | |
| FBA140A2VEB | RZAG100M7V1B | | 27.6 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.187 | 1.5 | | | | |
| FUA71AUVEB | x2 RZAG100M7V1B | | 27.9 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.046 x2 | 0.9 x2 | | | | |
| FAA71AUVEB | x2 RZAG100M7V1B | | 26.8 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.048 x2 | 0.4 x2 | | | | |
| FVA140AMVEB | RZAG100M7V1B | 27.5 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.276 | 1.4 | | | | | |
| FDXM35F3V1B | x4 RZAG100M7V1B | 27.2 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.034 x4 | 0.3 x4 | | | | | |
| FDXM50F3V1B | x3 RZAG100M7V1B | 27.6 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.5 x3 | | | | | |
| FHA35AVEB | x4 RZAG100M7V1B | 28.5 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x4 | 0.6 x4 | | | | | |
| FHA50AVEB | x3 RZAG100M7V1B | 27.9 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.6 x3 | | | | | |
| FHA71AVEB | x2 RZAG100M7V1B | 27.7 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.091 x2 | 0.6 x2 | | | | | |
| FHA140AVEB | RZAG100M7V1B | 27.9 | — | 32 | — | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.150 | 1.8 | | | | | |

3D110015A

3 Electrical data

3 - 1 Electrical Data

3

RZAG125-140MV1

| Indoor | Outdoor | Power supply | Voltage range | MCA | TOCA | MFA | Compressor | | OFM | | IFM | | |
|--------------|-----------------|-----------------|----------------------------------|----------------------------------|------|-----|------------|-------------|-------------|-------------|-----------|----------|--------|
| | | | | | | | MSC | RLA | kW | FLA | kW | FLA | |
| FCAHG125GVBE | RZAG125M7V1B | 50Hz ~ 220-240V | Minimum: 198 V Maximum: 264 V | 27.5 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.244 | 1.4 | |
| FCAG35AVEB | x4 RZAG125M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.044 x4 | 0.3 x4 | |
| FCAG50AVEB | x3 RZAG125M7V1B | | | 26.9 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.039 x3 | 0.3 x3 | |
| FCAG60AVEB | x2 RZAG125M7V1B | | | 26.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.044 x2 | 0.3 x2 | |
| FCAG125AVEB | RZAG125M7V1B | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.188 | 1.0 | |
| FFA35A2VEB | x4 RZAG125M7V1B | | | 27.7 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x4 | 0.4 x4 | |
| FFA50A2VEB | x3 RZAG125M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x3 | 0.4 x3 | |
| FFA60A2VEB | x2 RZAG125M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x2 | 0.6 x2 | |
| FBA35A2VEB | x4 RZAG125M7V1B | | | 28.5 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x4 | 0.6 x4 | |
| FBA50A2VEB | x3 RZAG125M7V1B | | | 27.9 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x3 | 0.6 x3 | |
| FBA60A2VEB | x2 RZAG125M7V1B | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.070 x2 | 0.5 x2 | |
| FBA125A2VEB | RZAG125M7V1B | | | 27.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.187 | 1.5 | |
| FNA35A2VEB | x4 RZAG125M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.034 x4 | 0.3 x4 | |
| FNA50A2VEB | x3 RZAG125M7V1B | | | 27.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.5 x3 | |
| FNA60A2VEB | x2 RZAG125M7V1B | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x2 | 0.5 x2 | |
| FUA125AVEB | RZAG125M7V1B | | | 27.5 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.106 | 1.4 | |
| FDA125A5VEB | RZAG125M7V1B | | | 28.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.350 | 2.1 | |
| FVA125AMVEB | RZAG125M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.238 | 1.2 | |
| FDXM35F3V1B | x4 RZAG125M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.034 x4 | 0.3 x4 | |
| FDXM50F3V1B | x3 RZAG125M7V1B | | | 27.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.5 x3 | |
| FDXM60F3V1B | x2 RZAG125M7V1B | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x2 | 0.5 x2 | |
| FHA35AVEB | x4 RZAG125M7V1B | | | 28.5 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x4 | 0.6 x4 | |
| FHA50AVEB | x3 RZAG125M7V1B | | | 27.9 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.6 x3 | |
| FHA60AVEB | x2 RZAG125M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.091 x2 | 0.6 x2 | |
| FHA125AVEB | RZAG125M7V1B | | 27.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.150 | 1.5 | | |
| FCAHG140GVBE | RZAG140M7V1B | | 50Hz ~ 220-240V | Minimum: 198 V Maximum: 264 V | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.091 x2 | 0.5 x2 |
| FCAG35AVEB | x4 RZAG140M7V1B | | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.044 x4 | 0.3 x4 |
| FCAG50AVEB | x3 RZAG140M7V1B | | | | 26.9 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.039 x3 | 0.3 x3 |
| FCAG71AVEB | x2 RZAG140M7V1B | | | | 26.8 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.054 x2 | 0.4 x2 |
| FCAG140AVEB | RZAG140M7V1B | | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.168 | 1.0 |
| FFA35A2VEB | x4 RZAG140M7V1B | | | | 27.7 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x4 | 0.4 x4 |
| FFA50A2VEB | x3 RZAG140M7V1B | | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x3 | 0.4 x3 |
| FFA60A2VEB | x2 RZAG140M7V1B | | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x2 | 0.6 x2 |
| FBA125A2VEB | x4 RZAG140M7V1B | | | | 28.5 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x4 | 0.6 x4 |
| FBA50A2VEB | x3 RZAG140M7V1B | | | | 27.9 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x3 | 0.6 x3 |
| FBA60A2VEB | x2 RZAG140M7V1B | | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.070 x2 | 0.5 x2 |
| FBA140A2VEB | RZAG140M7V1B | | | | 27.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.187 | 1.5 |
| FNA35A2VEB | x4 RZAG140M7V1B | | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.034 x4 | 0.3 x4 |
| FNA50A2VEB | x3 RZAG140M7V1B | | | | 27.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.5 x3 |
| FNA60A2VEB | x2 RZAG140M7V1B | | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x2 | 0.9 x2 |
| FUA140AVEB | RZAG140M7V1B | | | | 28.8 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.048 x2 | 0.4 x2 |
| FVA140AMVEB | RZAG140M7V1B | | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.117 x2 | 0.6 x2 |
| FVA140AMVEB | RZAG140M7V1B | | | | 27.5 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.276 | 1.4 |
| FDXM35F3V1B | x4 RZAG140M7V1B | | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.034 x4 | 0.3 x4 |
| FDXM50F3V1B | x3 RZAG140M7V1B | | | | 27.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.5 x3 |
| FHA35AVEB | x4 RZAG140M7V1B | | | | 28.5 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x4 | 0.6 x4 |
| FHA50AVEB | x3 RZAG140M7V1B | | | | 27.9 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.6 x3 |
| FHA71AVEB | x2 RZAG140M7V1B | | | | 27.7 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.091 x2 | 0.8 x2 |
| FHA140AVEB | RZAG140M7V1B | 27.9 | | | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.150 | 1.8 | |

3D110014A

RZAG125-140MV1

| Indoor | Outdoor | Power supply | Voltage range | MCA | TOCA | MFA | Compressor | | OFM | | IFM | |
|--------------|-----------------|-----------------|----------------------------------|------|------|-----|------------|------|-------------|-----------|----------|--------|
| | | | | | | | MSC | RLA | kW | FLA | kW | FLA |
| FCAHG140GVBE | RZAG140M7V1B | 50Hz ~ 220-240V | Minimum: 198 V Maximum: 264 V | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.091 x2 | 0.5 x2 |
| FCAG35AVEB | x4 RZAG140M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.044 x4 | 0.3 x4 |
| FCAG50AVEB | x3 RZAG140M7V1B | | | 26.9 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.039 x3 | 0.3 x3 |
| FCAG71AVEB | x2 RZAG140M7V1B | | | 26.8 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.054 x2 | 0.4 x2 |
| FCAG140AVEB | RZAG140M7V1B | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.168 | 1.0 |
| FFA35A2VEB | x4 RZAG140M7V1B | | | 27.7 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x4 | 0.4 x4 |
| FFA50A2VEB | x3 RZAG140M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.050 x3 | 0.4 x3 |
| FFA60A2VEB | x2 RZAG140M7V1B | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x2 | 0.6 x2 |
| FBA125A2VEB | x4 RZAG140M7V1B | | | 28.5 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x4 | 0.6 x4 |
| FBA50A2VEB | x3 RZAG140M7V1B | | | 27.9 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.089 x3 | 0.6 x3 |
| FBA60A2VEB | x2 RZAG140M7V1B | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.070 x2 | 0.5 x2 |
| FBA140A2VEB | RZAG140M7V1B | | | 27.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.187 | 1.5 |
| FNA35A2VEB | x4 RZAG140M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.034 x4 | 0.3 x4 |
| FNA50A2VEB | x3 RZAG140M7V1B | | | 27.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.5 x3 |
| FNA60A2VEB | x2 RZAG140M7V1B | | | 27.0 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x2 | 0.9 x2 |
| FUA140AVEB | RZAG140M7V1B | | | 28.8 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.048 x2 | 0.4 x2 |
| FVA140AMVEB | RZAG140M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.117 x2 | 0.6 x2 |
| FVA140AMVEB | RZAG140M7V1B | | | 27.5 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.276 | 1.4 |
| FDXM35F3V1B | x4 RZAG140M7V1B | | | 27.2 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.034 x4 | 0.3 x4 |
| FDXM50F3V1B | x3 RZAG140M7V1B | | | 27.6 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.5 x3 |
| FHA35AVEB | x4 RZAG140M7V1B | | | 28.5 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x4 | 0.6 x4 |
| FHA50AVEB | x3 RZAG140M7V1B | | | 27.9 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.060 x3 | 0.6 x3 |
| FHA71AVEB | x2 RZAG140M7V1B | | | 27.7 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.091 x2 | 0.8 x2 |
| FHA140AVEB | RZAG140M7V1B | | | 27.9 | - | 32 | - | 23.5 | 0.094+0.094 | 0.75+0.75 | 0.150 | 1.8 |

3D110015A

4 Options

4 - 1 Options

AZAS-MV1

AZAS-MY1

RZAG-MV1

RZAG-MY1

RZASG-MV1

RZASG-MY1

Available options for RZAG models

| Option | Option kit | | | |
|---------------------------|----------------------------|------------------------------|------------------------------|------------------------------|
| | RZAG71M7V1B RZAG71M7Y1B | RZAG100M7V1B RZAG100M7Y1B | RZAG125M7V1B RZAG125M7Y1B | RZAG140M7V1B RZAG140M7Y1B |
| Bottom plate heater | EKBPH140L7 | | | |
| Refrigerant branch piping | KHRQ22M20TA | | | |
| | Twin | KHRQ127H | | |
| | Triple | KHRQ22M20TA (3x) | | |
| | Double twin | KHRQ22M20TA (3x) | | |

Available options for RZASG models

| Option | Option kit | | | |
|---------------------------|--------------|--------------------------------|--------------------------------|--------------------------------|
| | RZASG71M2V1B | RZASG100M7V1B RZASG100M7Y1B | RZASG125M7V1B RZASG125M7Y1B | RZASG140M7V1B RZASG140M7Y1B |
| Bottom plate heater | - | | | |
| Refrigerant branch piping | KHRQ22M20TA | | | |
| | Twin | KHRQ127H | | |
| | Triple | KHRQ22M20TA (3x) | | |
| | Double twin | KHRQ22M20TA (3x) | | |

Available options for AZAS models

| Option | Option kit | | | |
|--------|-------------|------------------------------|------------------------------|------------------------------|
| | AZAS71M2V1B | AZAS100M7V1B AZAS100M7Y1B | AZAS125M7V1B AZAS125M7Y1B | AZAS140M7V1B AZAS140M7Y1B |
| | | | | |

3D108867

5 Combination table

5 - 1 Combination Table

5

AZAS-MV1
AZAS-MY1
RZAG-MV1
RZAG-MY1
RZASG-MV1
RZASG-MY1

Possible combinations

| Pair | 71 | 100 | 125 | 140 |
|----------------|-------|--------------|-----------------|--------------|
| 2= Twin | 35+35 | 50+50 | 60+60 | 71+71 |
| 3= Triple | | 35+35+35 (*) | 50+50+50 (*) | 50+50+50 (*) |
| 4= Double twin | | | 35+35+35+35 (*) | 35+35+35+35 |

(*) see note 1.

| Sky Air | High Cassette | | | | Thin cassette | | | | | | 2x2 cassette | | | Duct (medium ESP) | | | | Concealed floor standing type | | Ceiling-mounted 4-way blow | | Wall mounted type | | Duct (high ESP) | | | | | | | | | | |
|---------------|---------------|--------------|--------------|--------------|---------------|-------------|-------------|-------------|--------------|--------------|--------------|-------------|------------|-------------------|------------|------------|------------|-------------------------------|-------------|----------------------------|------------|-------------------|------------|-----------------|-------------|-------------|-------------|------------|-------------|-------------|-------------|--|--|--|
| | FCAG710Q/VEB | FCAG100Q/VEB | FCAG125Q/VEB | FCAG140Q/VEB | FCAG35A/VEB | FCAG50A/VEB | FCAG60A/VEB | FCAG71A/VEB | FCAG100A/VEB | FCAG125A/VEB | FCAG140A/VEB | FFAS35A/VEB | FFA60A/VEB | FFA60A/VEB | FBA35A/VEB | FBA60A/VEB | FBA71A/VEB | FBA100A/VEB | FBA125A/VEB | FBA140A/VEB | FNA35A/VEB | FNA50A/VEB | FNA60A/VEB | FUA71A/VEB | FUA100A/VEB | FUA125A/VEB | FUA140A/VEB | FAA71A/VEB | FAA100A/VEB | FAA125A/VEB | FAA140A/VEB | | | |
| RZAG71M7Y1B | RZAG71M7Y1B | P | | | 2 | | | | | | | 2 | | | 2 | | | | | | 2 | | | | | | | | | | | | | |
| RZAG100M7Y1B | RZAG100M7Y1B | | P | | | 3 | 2 | | | | | 3 | 2 | | 3 | 2 | | | | | 3 | 2 | | | | | | | | | | | | |
| RZAG125M7Y1B | RZAG125M7Y1B | | | P | | 4 | 3 | 2 | | | | 4 | 3 | 2 | 4 | 3 | 2 | | | | 4 | 3 | 2 | | | | | | | | | | | |
| RZAG140M7Y1B | RZAG140M7Y1B | 2 | | | P | 4 | 3 | | | | | 4 | 3 | | 4 | 3 | | | | | 4 | 3 | | | | | | | | | | | | |
| RZASG71M2V1B | RZASG71M2V1B | | | | | | | | | | | 2 | | | 2 | | | | | | | | | | | | | | | | | | | |
| RZASG100M7Y1B | RZASG100M7Y1B | | | | | 3 | 2 | | | | | 3 | 2 | | 3 | 2 | | | | | 3 | 2 | | | | | | | | | | | | |
| RZASG125M7Y1B | RZASG125M7Y1B | | | | | 4 | 3 | 2 | | | | 4 | 3 | 2 | 4 | 3 | 2 | | | | 4 | 3 | 2 | | | | | | | | | | | |
| RZASG140M7Y1B | RZASG140M7Y1B | | | | | 4 | 3 | | | | | 4 | 3 | | 4 | 3 | | | | | 4 | 3 | | | | | | | | | | | | |
| AZAS71M2V1B | AZAS71M2V1B | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| AZAS100M7Y1B | AZAS100M7Y1B | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| AZAS125M7Y1B | AZAS125M7Y1B | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| AZAS140M7Y1B | AZAS140M7Y1B | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

| Sky Air | Floor standing type | | | | Slim duct | | | Ceiling-suspended | | | | | | |
|---------------|---------------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------------|------------|------------|------------|-------------|-------------|-------------|
| | FVA71A/VEB | FVA100A/VEB | FVA125A/VEB | FVA140A/VEB | FDXA35F3Y1B | FDXA50F3Y1B | FDXA60F3Y1B | FHA35A/VEB | FHA50A/VEB | FHA60A/VEB | FHA71A/VEB | FHA100A/VEB | FHA125A/VEB | FHA140A/VEB |
| RZAG71M7Y1B | RZAG71M7Y1B | P | | | | | | 2 | | | | | | |
| RZAG100M7Y1B | RZAG100M7Y1B | | P | | | | | 3 | 2 | | | | | |
| RZAG125M7Y1B | RZAG125M7Y1B | | | P | | | | 4 | 3 | 2 | | | | |
| RZAG140M7Y1B | RZAG140M7Y1B | 2 | | | P | | | 4 | 3 | | | | | |
| RZASG71M2V1B | RZASG71M2V1B | | | | | | | | | | | | | |
| RZASG100M7Y1B | RZASG100M7Y1B | | | | | | | 3 | 2 | | | | | |
| RZASG125M7Y1B | RZASG125M7Y1B | | | | | | | 4 | 3 | 2 | | | | |
| RZASG140M7Y1B | RZASG140M7Y1B | 2 | | | P | | | 4 | 3 | | | | | |
| AZAS71M2V1B | AZAS71M2V1B | | | | | | | | | | | | | |
| AZAS100M7Y1B | AZAS100M7Y1B | | | | | | | | | | | | | |
| AZAS125M7Y1B | AZAS125M7Y1B | | | | | | | | | | | | | |
| AZAS140M7Y1B | AZAS140M7Y1B | | | | | | | | | | | | | |

Notes

- Maximum capacity is limited based on outdoor unit capacity.
- When combining multiple indoor units, designate the unit whose remote controller is equipped with the most functions as the master unit.
- For the selection of the correct refnet kit, required to install a multi-combination, refer to the option list.

Twin : KHRQ(M)58T
 Triple : KHRQ(M)58H
 Double twin : KHRQ(M)58T

3D108868

RZAG-MV1
RZAG-MY1

| Sky Air | High Cassette | | | | Thin cassette | | | | | | 2x2 cassette | | | Duct (medium ESP) | | | | Concealed floor standing type | | Ceiling-mounted 4-way blow | | Wall mounted type | | Duct (high ESP) | | | | | | | | | |
|--------------|---------------|--------------|--------------|--------------|---------------|-------------|-------------|-------------|--------------|--------------|--------------|-------------|------------|-------------------|------------|------------|------------|-------------------------------|-------------|----------------------------|------------|-------------------|------------|-----------------|-------------|-------------|-------------|------------|-------------|-------------|-------------|--|--|
| | FCAG71G/VEB | FCAG100G/VEB | FCAG125G/VEB | FCAG140G/VEB | FCAG35A/VEB | FCAG50A/VEB | FCAG60A/VEB | FCAG71A/VEB | FCAG100A/VEB | FCAG125A/VEB | FCAG140A/VEB | FFAS35A/VEB | FFA60A/VEB | FFA60A/VEB | FBA35A/VEB | FBA60A/VEB | FBA71A/VEB | FBA100A/VEB | FBA125A/VEB | FBA140A/VEB | FNA35A/VEB | FNA50A/VEB | FNA60A/VEB | FUA71A/VEB | FUA100A/VEB | FUA125A/VEB | FUA140A/VEB | FAA71A/VEB | FAA100A/VEB | FAA125A/VEB | FAA140A/VEB | | |
| RZAG71M7Y1B | RZAG71M7Y1B | | P | | | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| RZAG100M7Y1B | RZAG100M7Y1B | 2 | | | P | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| RZAG125M7Y1B | RZAG125M7Y1B | | | | P | | | | | | | | | | | | | | | | | | | | | | | | | | | | |
| RZAG140M7Y1B | RZAG140M7Y1B | 2 | | | P | | | | | | | | | | | | | | | | | | | | | | | | | | | | |

| Sky Air | Floor standing type | | | | Slim duct | | | Ceiling-suspended | | | | | | |
|--------------|---------------------|-------------|-------------|-------------|-------------|-------------|-------------|-------------------|------------|------------|------------|-------------|-------------|-------------|
| | FVA71A/VEB | FVA100A/VEB | FVA125A/VEB | FVA140A/VEB | FDXA35F3Y1B | FDXA50F3Y1B | FDXA60F3Y1B | FHA35A/VEB | FHA50A/VEB | FHA60A/VEB | FHA71A/VEB | FHA100A/VEB | FHA125A/VEB | FHA140A/VEB |
| RZAG71M7Y1B | RZAG71M7Y1B | | P | | | | | 3 | 2 | | | | | |
| RZAG100M7Y1B | RZAG100M7Y1B | | | P | | | | 4 | 3 | | | | | |
| RZAG125M7Y1B | RZAG125M7Y1B | | | | P | | | 4 | 3 | 2 | | | | |
| RZAG140M7Y1B | RZAG140M7Y1B | | | | P | | | 4 | 3 | | | | | |

Possible combinations P= Pair
 2= Twin
 3= Triple
 4= Double twin

Notes

- Maximum capacity is limited based on outdoor unit capacity.
- When combining multiple indoor units, designate the unit whose remote controller is equipped with the most functions as the master unit.
- For the selection of the correct refnet kit, required to install a multi-combination, refer to the option list.



Twin : KHRQ(M)58T
 Triple : KHRQ(M)58H
 Double twin : KHRQ(M)58T

3D108869

6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

RZAG71MV1 RZAG71MY1

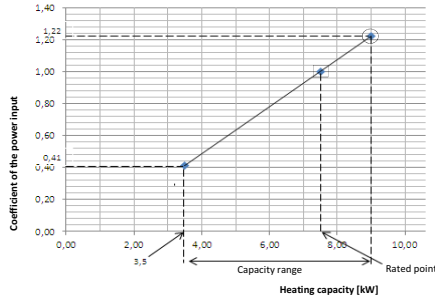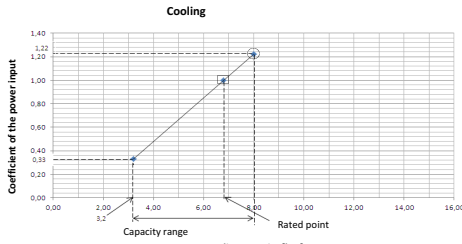

Heating

Symbols
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 Pi: Power input [kW]
 compressor + indoor and outdoor fan motors

| Indoor | | Outdoor temperature [°C DB] | | | | | | | | | | | | |
|--------|------|-----------------------------|------|------|------|------|------|------|------|------|------|------|------|------|
| | | 25 | | | 30 | | | 35 | | | 40 | | | |
| °CWB | °CDB | kW | SHC | CPI | kW | SHC | CPI | kW | SHC | CPI | kW | SHC | CPI | |
| 16 | 16 | 6.43 | 0.98 | 0.93 | 7.09 | 0.99 | 0.93 | 7.65 | 1.02 | 0.93 | 8.21 | 1.06 | 0.93 | 8.79 |
| 18 | 18 | 6.43 | 0.98 | 0.93 | 7.09 | 0.99 | 0.93 | 7.65 | 1.02 | 0.93 | 8.21 | 1.06 | 0.93 | 8.79 |
| 20 | 20 | 6.42 | 1.01 | 1.01 | 7.07 | 1.07 | 1.01 | 7.63 | 1.12 | 1.01 | 8.19 | 1.16 | 1.01 | 8.77 |
| 21 | 21 | 6.42 | 1.03 | 1.03 | 7.07 | 1.09 | 1.03 | 7.63 | 1.13 | 1.03 | 8.19 | 1.17 | 1.03 | 8.77 |
| 22 | 22 | 6.42 | 1.06 | 1.06 | 7.06 | 1.11 | 1.06 | 7.62 | 1.15 | 1.06 | 8.18 | 1.19 | 1.06 | 8.77 |
| 24 | 24 | 6.41 | 1.09 | 1.09 | 7.05 | 1.15 | 1.09 | 7.61 | 1.20 | 1.09 | 8.17 | 1.23 | 1.09 | 8.76 |

| Indoor | | Outdoor temperature [°C WB] | | | | | | | | | | | |
|--------|------|-----------------------------|------|-------|------|------|------|------|------|------|------|------|------|
| | | -15.0 | | -10.0 | | -5.0 | | 0.0 | | 6.0 | | 10.0 | |
| °CDB | kW | TC | CPI | TC | CPI | TC | CPI | TC | CPI | TC | CPI | TC | CPI |
| 16 | 6.44 | 0.93 | 0.93 | 7.09 | 0.99 | 7.65 | 1.02 | 7.79 | 1.06 | 9.00 | 1.12 | 9.71 | 1.19 |
| 18 | 6.43 | 0.98 | 0.98 | 7.08 | 1.03 | 7.64 | 1.07 | 7.78 | 1.10 | 9.00 | 1.17 | 9.71 | 1.24 |
| 20 | 6.42 | 1.01 | 1.01 | 7.07 | 1.07 | 7.63 | 1.12 | 7.77 | 1.14 | 9.00 | 1.22 | 9.71 | 1.28 |
| 21 | 6.42 | 1.03 | 1.03 | 7.07 | 1.09 | 7.63 | 1.13 | 7.77 | 1.16 | 9.00 | 1.24 | 9.71 | 1.31 |
| 22 | 6.42 | 1.06 | 1.06 | 7.06 | 1.11 | 7.62 | 1.15 | 7.76 | 1.19 | 9.00 | 1.27 | 9.71 | 1.33 |
| 24 | 6.41 | 1.09 | 1.09 | 7.05 | 1.15 | 7.61 | 1.20 | 7.75 | 1.23 | 9.00 | 1.32 | 9.67 | 1.38 |

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 - = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units EWB & EDB.
SHC for other dry-bulb temperatures = SHC + SHC*
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1.8F) x (DB* - EDB)
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The heating performance takes into account the drop that occurs during defrost operation.
 - The air flow rate and bypass factor are mentioned in the table.

9. The rated power input for each model is mentioned in the table below.

| Pair | FCAG71G | FCAG71A | FAA71A | FVA71A | FHA71A | FUA71A | FBA71A |
|------|---------|---------|--------|--------|--------|--------|--------|
| AFR | 21.2 | 15.3 | 18.0 | 18.0 | 20.5 | 23.0 | 18.0 |
| BF | (0.20) | (0.14) | (0.16) | (0.16) | (0.13) | (0.24) | (0.13) |



| Pair | FCAG71G | FCAG71A | FAA71A | FVA71A | FHA71A | FUA71A | FBA71A |
|---------|---------|---------|--------|--------|--------|--------|--------|
| Cooling | 1.55 | 1.78 | 1.88 | 1.87 | 1.64 | 1.61 | 1.86 |
| Heating | 1.60 | 2.29 | 2.19 | 2.33 | 2.07 | 1.95 | 2.10 |

| Twin | | FCAG35A X 2 | FHA35A X 2 | FFA35A X 2 | FDWM35F3 X 2 | FBA35A X 2 | FNA35A X 2 |
|------|------------|-------------|------------|------------|--------------|------------|------------|
| AFR | 12.5 x 2 | 14.0 x 2 | 10.0 x 2 | 8.7 x 2 | 15.0 x 2 | 8.7 x 2 | 8.7 x 2 |
| BF | (0.40 x 2) | (0.17 x 2) | (0.25 x 2) | (0.17 x 2) | (0.08 x 2) | (0.17 x 2) | (0.17 x 2) |

| Twin | | FCAG35A X 2 | FHA35A X 2 | FFA35A X 2 | FDWM35F3 X 2 | FBA35A X 2 | FNA35A X 2 |
|---------|------|-------------|------------|------------|--------------|------------|------------|
| Cooling | 1.47 | 1.33 | 1.63 | 1.73 | 1.62 | 1.73 | 1.82 |
| Heating | 1.53 | 1.62 | 1.74 | 2.17 | 1.82 | 2.17 | 2.17 |

3D112140

RZAG100MV1 RZAG100MY1

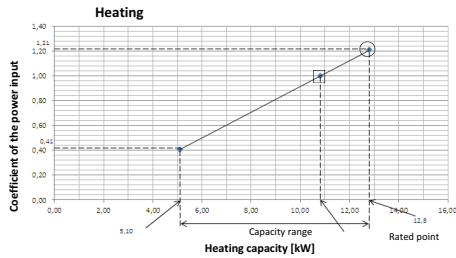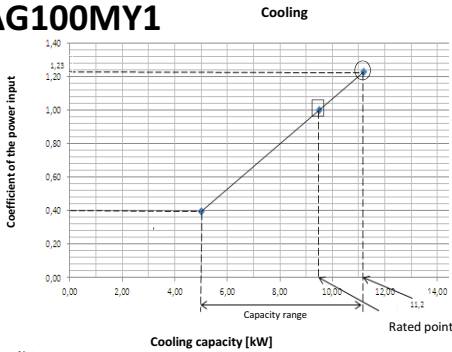

Symbols
 AFR: Air flow rate [m³/min]
 BF: Bypass factor
 EWB: Entering wet-bulb temperature (°C WB)
 EDB: Entering dry-bulb temperature (°C DB)
 TC: Maximum total cooling/heating capacity [kW]
 SHC: Sensible heat capacity [kW]
 CPI: Coefficient of the power input
 Pi: Power input [kW]
 compressor + indoor and outdoor fan motors

- Notes**
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 - = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units EWB & EDB.
SHC for other dry-bulb temperatures = SHC + SHC*
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1.8F) x (DB* - EDB)
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The heating performance takes into account the drop that occurs during defrost operation.
 - The air flow rate and bypass factor are mentioned in the table.

| Indoor | | Outdoor temperature [°C DB] | | | | | | | | | | | |
|--------|------|-----------------------------|------|------|-------|------|------|-------|------|------|-------|------|------|
| | | 25 | | | 30 | | | 35 | | | 40 | | |
| °CWB | °CDB | kW | SHC | CPI | kW | SHC | CPI | kW | SHC | CPI | kW | SHC | CPI |
| 16.0 | 22 | 11.20 | 7.61 | 1.01 | 10.85 | 7.44 | 1.11 | 10.50 | 7.29 | 1.22 | 10.11 | 7.09 | 1.32 |
| 18.0 | 25 | 13.80 | 7.59 | 1.01 | 11.37 | 7.49 | 1.12 | 11.00 | 7.27 | 1.23 | 10.55 | 7.09 | 1.33 |
| 19.5 | 27 | 12.15 | 7.59 | 1.02 | 11.62 | 7.44 | 1.12 | 11.20 | 7.26 | 1.23 | 10.80 | 7.04 | 1.33 |
| 20 | 30 | 12.80 | 7.52 | 1.02 | 11.74 | 7.37 | 1.13 | 11.43 | 7.34 | 1.23 | 10.91 | 7.04 | 1.34 |
| 22.0 | 30 | 12.80 | 7.52 | 1.02 | 12.37 | 7.36 | 1.13 | 11.90 | 7.16 | 1.24 | 11.52 | 7.03 | 1.35 |
| 24.0 | 32 | 13.30 | 7.42 | 1.03 | 12.88 | 7.27 | 1.14 | 12.40 | 7.06 | 1.25 | 11.97 | 6.91 | 1.36 |

9. The rated power input for each model is mentioned in the table below.

| Pair | FCAG100G | FCAG100A | FAA100A | FVA100A | FHA100A | FUA100A | FBA100A |
|------|----------|----------|---------|---------|---------|---------|---------|
| AFR | 32.3 | 22.8 | 26.0 | 28.0 | 28.0 | 31.0 | 29.0 |
| BF | (0.17) | (0.17) | (0.10) | (0.20) | (0.09) | (0.20) | (0.03) |

| Pair | FCAG100G | FCAG100A | FAA100A | FVA100A | FHA100A | FUA100A | FBA100A |
|---------|----------|----------|---------|---------|---------|---------|---------|
| Cooling | 1.88 | 2.15 | 2.14 | 2.24 | 1.95 | 2.24 | 2.26 |
| Heating | 2.12 | 2.72 | 3.45 | 2.88 | 2.58 | 2.62 | 2.78 |

| Twin | | FCAG50A X 2 | FHA50A X 2 | FFA50A X 2 | FDWM50F3 X 2 | FBA50A X 2 | FNA50A X 2 |
|------|------------|-------------|------------|------------|--------------|------------|------------|
| AFR | 12.5 x 2 | 15.0 x 2 | 12.0 x 2 | 15.8 x 2 | 15.0 x 2 | 16.0 x 2 | 16.0 x 2 |
| BF | (0.22 x 2) | (0.18 x 2) | (0.16 x 2) | (0.11 x 2) | (0.13 x 2) | (0.11 x 2) | (0.11 x 2) |

| Twin | | FCAG50A X 2 | FHA50A X 2 | FFA50A X 2 | FDWM50F3 X 2 | FBA50A X 2 | FNA50A X 2 |
|---------|------|-------------|------------|------------|--------------|------------|------------|
| Cooling | 1.94 | 1.95 | 2.50 | 1.89 | 1.98 | 1.98 | 1.89 |
| Heating | 2.04 | 2.55 | 3.16 | 2.47 | 2.68 | 2.47 | 2.47 |

| Triple | | FCAG35A X 3 | FHA35A X 3 | FFA35A X 3 | FDWM35F3 X 3 | FBA35A X 3 | FNA35A X 3 |
|--------|------------|-------------|------------|------------|--------------|------------|------------|
| AFR | 12.5 x 3 | 14.0 x 3 | 10.0 x 3 | 8.7 x 3 | 15.0 x 3 | 8.7 x 3 | 8.7 x 3 |
| BF | (0.40 x 3) | (0.17 x 3) | (0.25 x 3) | (0.17 x 3) | (0.08 x 3) | (0.17 x 3) | (0.17 x 3) |

| Triple | | FCAG35A X 3 | FHA35A X 3 | FFA35A X 3 | FDWM35F3 X 3 | FBA35A X 3 | FNA35A X 3 |
|---------|------|-------------|------------|------------|--------------|------------|------------|
| Cooling | 1.74 | 1.84 | 2.02 | 1.99 | 2.21 | 1.99 | 1.99 |
| Heating | 2.07 | 2.06 | 3.14 | 2.85 | 2.33 | 2.85 | 2.85 |


3D112141

6 Capacity tables

6 - 1 Cooling/Heating Capacity Tables

6

RZAG125MV1 RZAG125MY1

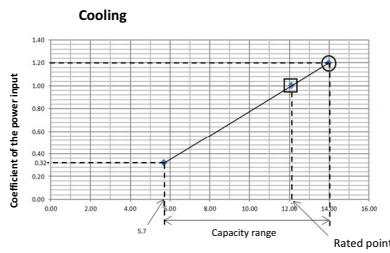

Cooling capacity [kW]


- Notes
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 - ▢ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units EWB & EDB.
SHC for other dry-bulb temperatures = SHC - SHC*
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The heating performance takes into account the drop that occurs during defrost operation.
 - The air flow rate and bypass factor are mentioned in the table.

| Pair | FCAG125G | FCAG125A | FD1A125A | FVA125A | FHA125A | FUA125A | FBA125A |
|------|----------|----------|----------|---------|---------|---------|---------|
| AFR | 33.5 | 26.0 | 39.0 | 28.0 | 31.0 | 32.5 | 34.0 |
| (BF) | (0.19) | (0.21) | (0.16) | (0.16) | (0.14) | (0.19) | (0.06) |

| Twin | FCAG60A X 2 | FHA60A X 2 | FFA60A X 2 | FDXM50F3 X 2 | FBA60A X 2 | FNA60A X 2 |
|------|-------------|------------|------------|--------------|------------|------------|
| AFR | 13.5 x 2 | 19.5 x 2 | 14.5 x 2 | 18.0 x 2 | 18.0 x 2 | 16.0 x 2 |
| (BF) | (0.20 x 2) | (0.20 x 2) | (0.11 x 2) | (0.12 x 2) | (0.18 x 2) | (0.12 x 2) |

| Triple | FCAG50A X 3 | FHA50A X 3 | FFA50A X 3 | FDXM50F3 X 3 | FBA50A X 3 | FNA50A X 3 |
|--------|-------------|------------|------------|--------------|------------|------------|
| AFR | 12.6 x 3 | 15.0 x 3 | 12.0 x 3 | 15.8 x 3 | 15.0 x 3 | 16.0 x 3 |
| (BF) | (0.22 x 3) | (0.18 x 3) | (0.16 x 3) | (0.11 x 3) | (0.13 x 3) | (0.11 x 3) |

| Double twin | FCAG35A X 4 | FHA35A X 4 | FFA35A X 4 | FDXM35F3 X 4 | FBA35A X 4 | FNA35A X 4 |
|-------------|-------------|------------|------------|--------------|------------|------------|
| AFR | 12.5 x 4 | 14.0 x 4 | 10.0 x 4 | 8.7 x 4 | 15.0 x 4 | 8.7 x 4 |
| (BF) | (0.40 x 4) | (0.17 x 4) | (0.25 x 4) | (0.17 x 4) | (0.08 x 4) | (0.17 x 4) |

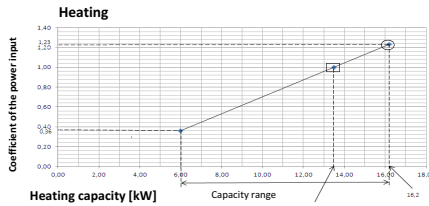

Heating capacity [kW]

| Indoor | Outdoor temperature [°C DB] | | | | | | | | | | | | |
|--------|-----------------------------|-------|------|------|-------|------|------|-------|------|------|-------|------|------|
| | 25 | | | 30 | | | 35 | | | 40 | | | |
| °CWB | °CDB | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | |
| 16.0 | 22 | 14.39 | 9.54 | 0.99 | 13.69 | 9.30 | 1.09 | 13.30 | 9.12 | 1.19 | 12.60 | 8.78 | 1.29 |
| 18.0 | 25 | 14.70 | 9.50 | 0.99 | 14.20 | 9.32 | 1.09 | 13.70 | 9.09 | 1.20 | 13.20 | 8.83 | 1.30 |
| 19.0 | 27 | 15.00 | 9.52 | 1.00 | 14.50 | 9.34 | 1.10 | 14.00 | 9.06 | 1.20 | 13.50 | 8.87 | 1.31 |
| 19.5 | 27 | 15.21 | 9.52 | 1.00 | 14.68 | 9.26 | 1.11 | 14.15 | 9.08 | 1.20 | 13.64 | 8.81 | 1.31 |
| 22.0 | 30 | 16.00 | 9.39 | 1.00 | 15.47 | 9.14 | 1.11 | 14.90 | 8.95 | 1.21 | 14.38 | 8.74 | 1.32 |
| 25.0 | 32 | 16.70 | 9.31 | 1.01 | 16.50 | 9.09 | 1.11 | 15.50 | 8.83 | 1.23 | 14.97 | 8.63 | 1.33 |

| Indoor | Outdoor temperature [°C WB] | | | | | | | | | | | |
|--------|-----------------------------|------|-------|------|------|------|------|------|------|------|------|------|
| | -15.0 | | -10.0 | | -5.0 | | 0.0 | | 6.0 | | 10.0 | |
| °C DB | kW | CPI | TC | CPI | TC | CPI | TC | CPI | TC | CPI | TC | CPI |
| 16 | 11.0 | 0.94 | 12.1 | 1.00 | 12.9 | 1.03 | 13.2 | 1.06 | 16.2 | 1.13 | 17.5 | 1.20 |
| 18 | 11.0 | 0.98 | 12.1 | 1.03 | 12.9 | 1.08 | 13.2 | 1.11 | 16.2 | 1.18 | 17.5 | 1.25 |
| 20 | 11.0 | 1.02 | 12.0 | 1.03 | 12.9 | 1.10 | 13.2 | 1.15 | 16.2 | 1.23 | 17.5 | 1.30 |
| 21 | 11.0 | 1.04 | 12.0 | 1.10 | 12.8 | 1.14 | 13.2 | 1.17 | 16.2 | 1.25 | 17.5 | 1.32 |
| 22 | 11.0 | 1.06 | 12.0 | 1.12 | 12.8 | 1.16 | 13.2 | 1.20 | 16.2 | 1.28 | 17.4 | 1.34 |
| 24 | 11.0 | 1.10 | 12.0 | 1.16 | 12.8 | 1.21 | 13.2 | 1.24 | 16.2 | 1.33 | 17.4 | 1.39 |

9. The rated power input for each model is mentioned in the table below.

| Pair | FCAG125G | FCAG125A | FD1A125A | FVA125A | FHA125A | FUA125A | FBA125A |
|---------|----------|----------|----------|---------|---------|---------|---------|
| Cooling | 2.81 | 3.17 | 3.17 | 3.72 | 2.94 | 3.98 | 3.64 |
| Heating | 3.02 | 5.83 | 3.61 | 4.63 | 4.21 | 4.24 | 3.75 |


| Twin | FCAG60A X 2 | FHA60A X 2 | FFA60A X 2 | FDXM50F3 X 2 | FBA60A X 2 | FNA60A X 2 |
|---------|-------------|------------|------------|--------------|------------|------------|
| Cooling | 2.57 | 2.78 | 3.09 | 2.42 | 3.21 | 2.47 |
| Heating | 3.45 | 4.31 | 3.63 | 3.63 | 3.32 | 3.63 |

| Triple | FCAG50A X 3 | FHA50A X 3 | FFA50A X 3 | FDXM50F3 X 3 | FBA50A X 3 | FNA50A X 3 |
|---------|-------------|------------|------------|--------------|------------|------------|
| Cooling | 2.25 | 2.69 | 2.78 | 2.09 | 3.10 | 2.09 |
| Heating | 2.84 | 3.28 | 3.26 | 2.92 | 3.13 | 2.92 |

| Double twin | FCAG35A X 4 | FHA35A X 4 | FFA35A X 4 | FDXM35F3 X 4 | FBA35A X 4 | FNA35A X 4 |
|-------------|-------------|------------|------------|--------------|------------|------------|
| Cooling | 2.06 | 2.05 | 2.43 | 2.36 | 2.93 | 2.44 |
| Heating | 2.59 | 2.86 | 3.50 | 3.44 | 2.87 | 3.44 |

3D112142

RZAG140MV1 RZAG140MY1

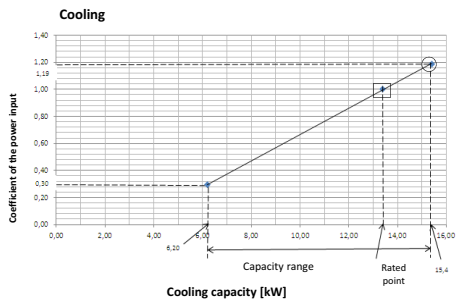

Cooling capacity [kW]


- Notes
- The ratings shown are net capacities which include a deduction for indoor fan motor heat.
 - = Maximum at standard conditions
 - ▢ = Rated capacity and rated coefficient of the power input
The maximum capacity is not guaranteed except at standard conditions.
 - SHC is based on indoor units EWB & EDB.
SHC for other dry-bulb temperatures = SHC + SHC*
SHC* = SHC correction for other dry-bulb temperatures
= 0.02 x AFR (m³/min) x (1-BF) x (DB* - EDB)
 - The capacities are based on the following conditions:
Outdoor air: 85% RH
However, the outdoor ambient condition of the rated capacity during heating operation is 7°C DB / 6°C WB.
Corresponding refrigerant piping length: 5.0 m
Level difference: 0m
 - CPI is a percentage value compared to the rated value which is 1.00.
 - The error rate for this value is less than 5% and depends on the indoor unit type.
 - The heating performance takes into account the drop that occurs during defrost operation.
 - The air flow rate and bypass factor are mentioned in the table.

| Pair | FCAG140G | FCAG140A | FVA140A | FHA140A | FBA140A |
|------|----------|----------|---------|---------|---------|
| AFR | 33.5 | 26.0 | 30.0 | 34.0 | 34.0 |
| (BF) | (0.15) | (0.23) | (0.18) | (0.17) | (0.06) |

| Twin | FCAG70G X 2 | FCAG70A X 2 | FHA70A X 2 | FVA70A X 2 | FHA70A X 2 | FBA70A X 2 | FNA70A X 2 |
|------|-------------|-------------|------------|------------|------------|------------|------------|
| AFR | 21.2 x 2 | 15.1 x 2 | 18.0 x 2 | 20.5 x 2 | 23.0 x 2 | 18.0 x 2 | 18.0 x 2 |
| (BF) | (0.20 x 2) | (0.14 x 2) | (0.16 x 2) | (0.13 x 2) | (0.24 x 2) | (0.13 x 2) | (0.16 x 2) |

| Triple | FCAG50A X 3 | FHA50A X 3 | FFA50A X 3 | FDXM50F3 X 3 | FBA50A X 3 | FNA50A X 3 |
|--------|-------------|------------|------------|--------------|------------|------------|
| AFR | 12.6 x 3 | 15.0 x 3 | 12.0 x 3 | 15.8 x 3 | 15.0 x 3 | 16.0 x 3 |
| (BF) | (0.22 x 3) | (0.18 x 3) | (0.16 x 3) | (0.11 x 3) | (0.13 x 3) | (0.11 x 3) |

| Double twin | FCAG35A X 4 | FHA35A X 4 | FFA35A X 4 | FDXM35F3 X 4 | FBA35A X 4 | FNA35A X 4 |
|-------------|-------------|------------|------------|--------------|------------|------------|
| AFR | 12.5 x 4 | 14.0 x 4 | 10.0 x 4 | 8.7 x 4 | 15.0 x 4 | 8.7 x 4 |
| (BF) | (0.40 x 4) | (0.20 x 4) | (0.25 x 4) | (0.17 x 4) | (0.08 x 4) | (0.17 x 4) |

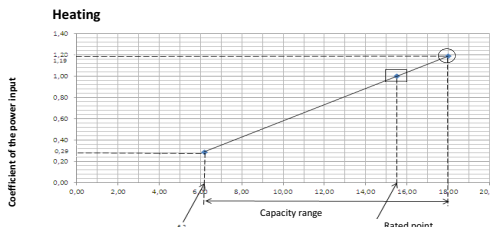

Heating capacity [kW]

| Indoor | Outdoor temperature [°C DB] | | | | | | | | | | | | |
|--------|-----------------------------|-------|-------|------|-------|-------|------|-------|-------|------|-------|------|------|
| | 25 | | | 30 | | | 35 | | | 40 | | | |
| °CWB | °CDB | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | TC | SHC | CPI | |
| 16.0 | 22 | 15.50 | 10.47 | 0.98 | 14.83 | 10.25 | 1.08 | 14.44 | 10.03 | 1.18 | 13.86 | 9.69 | 1.28 |
| 18.0 | 25 | 16.87 | 10.38 | 0.98 | 15.63 | 10.23 | 1.08 | 15.11 | 10.01 | 1.19 | 14.83 | 9.71 | 1.30 |
| 19.0 | 27 | 16.56 | 10.43 | 0.99 | 15.86 | 10.18 | 1.09 | 15.40 | 9.98 | 1.19 | 14.83 | 9.76 | 1.30 |
| 19.5 | 27 | 16.74 | 10.49 | 0.99 | 16.14 | 10.16 | 1.10 | 15.57 | 10.00 | 1.19 | 14.98 | 9.66 | 1.30 |
| 22.0 | 30 | 17.61 | 10.37 | 0.99 | 17.01 | 10.16 | 1.10 | 16.36 | 9.83 | 1.21 | 15.76 | 9.60 | 1.31 |
| 25.0 | 32 | 18.38 | 10.20 | 1.00 | 17.72 | 10.00 | 1.11 | 17.04 | 9.67 | 1.22 | 16.43 | 9.47 | 1.32 |

| Indoor | Outdoor temperature [°C WB] | | | | | | | | | | | |
|--------|-----------------------------|------|-------|------|------|------|------|------|------|------|------|------|
| | -15.0 | | -10.0 | | -5.0 | | 0.0 | | 6.0 | | 10.0 | |
| °C DB | kW | CPI | TC | CPI | TC | CPI | TC | CPI | TC | CPI | TC | CPI |
| 16 | 11.6 | 0.91 | 12.7 | 0.97 | 13.6 | 1.00 | 13.9 | 1.03 | 18.0 | 1.09 | 19.4 | 1.16 |
| 18 | 11.6 | 0.95 | 12.7 | 1.00 | 13.6 | 1.04 | 13.9 | 1.07 | 18.0 | 1.14 | 19.4 | 1.21 |
| 20 | 11.6 | 0.99 | 12.7 | 1.05 | 13.5 | 1.09 | 13.9 | 1.11 | 18.0 | 1.19 | 19.4 | 1.25 |
| 21 | 11.5 | 1.00 | 12.7 | 1.06 | 13.5 | 1.11 | 13.9 | 1.13 | 18.0 | 1.21 | 19.4 | 1.28 |
| 22 | 11.5 | 1.02 | 12.7 | 1.08 | 13.5 | 1.12 | 13.9 | 1.16 | 18.0 | 1.24 | 19.4 | 1.30 |
| 24 | 11.5 | 1.07 | 12.6 | 1.12 | 13.5 | 1.17 | 13.9 | 1.20 | 18.0 | 1.29 | 19.4 | 1.35 |

9. The rated power input for each model is mentioned in the table below.

| Pair | FCAG140G | FCAG140A | FVA140A | FHA140A | FBA140A |
|---------|----------|----------|---------|---------|---------|
| Cooling | 3.44 | 4.21 | 4.61 | 4.49 | 4.30 |
| Heating | 3.49 | 5.83 | 5.56 | 3.46 | 5.04 |

| Twin | FCAG70G X 2 | FCAG70A X 2 | FHA70A X 2 | FVA70A X 2 | FHA70A X 2 | FBA70A X 2 | FNA70A X 2 |
|---------|-------------|-------------|------------|------------|------------|------------|------------|
| Cooling | 2.71 | 3.59 | 3.77 | 3.54 | 3.30 | 3.49 | 3.23 |
| Heating | 2.79 | 4.79 | 3.05 | 3.10 | 3.90 | 4.82 | 5.24 |

| Triple | FCAG50A X 3 | FHA50A X 3 | FFA50A X 3 | FDXM50F3 X 3 | FBA50A X 3 | FNA50A X 3 |
|---------|-------------|------------|------------|--------------|------------|------------|
| Cooling | 3.10 | 3.85 | 3.89 | 2.95 | 3.59 | 2.95 |
| Heating | 4.46 | 2.96 | 5.18 | 3.96 | 4.29 | 3.96 |


| Double twin | FCAG35A X 4 | FHA35A X 4 | FFA35A X 4 | FDXM35F3 X 4 | FBA35A X 4 | FNA35A X 4 |
|-------------|-------------|------------|------------|--------------|------------|------------|
| Cooling | 2.82 | 2.86 | 3.34 | 3.34 | 3.35 | 3.34 |
| Heating | 5.84 | 3.31 | 5.60 | 4.67 | 3.81 | 4.67 |

3D112143



7 Dimensional drawings

7 - 1 Dimensional Drawings

AZAS100-140MV1
 AZAS-MY1
 RZAG71MV1 M12
 RZAG71MY1
 RZASG100-140MV1
 RZASG-MY1

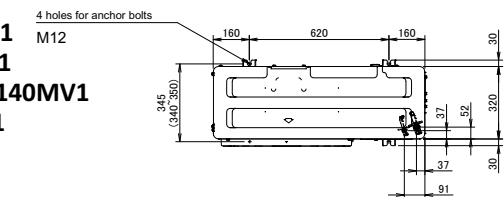




| Model | AA | AB |
|--|-----|-----|
| RZAG71* / RZASG100-125* / AZAS100-125* | 331 | 337 |
| RZASG140* / AZAS140* | 414 | 420 |

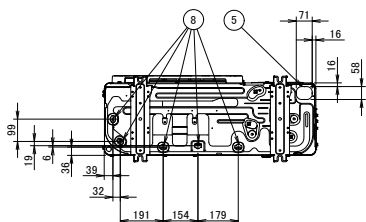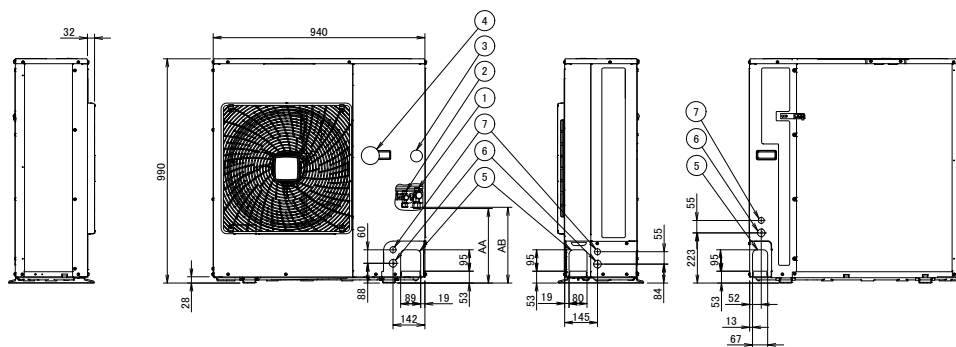

- ① Gas pipe connection Ø15.9 flare
- ② Liquid pipe connection Ø9.5 flare
- ③ Service port (in the unit)
- ④ Electronic connection and grounding terminal M5 (in the switch box)
- ⑤ Refrigerant piping intake
- ⑥ Power supply wiring intake (knockout hole Ø34)
- ⑦ Control wiring intake (knockout hole Ø27)
- ⑧ Drain outlet

3D110011

RZAG100-140MV1
 RZAG100-140MY1

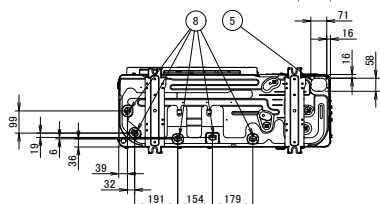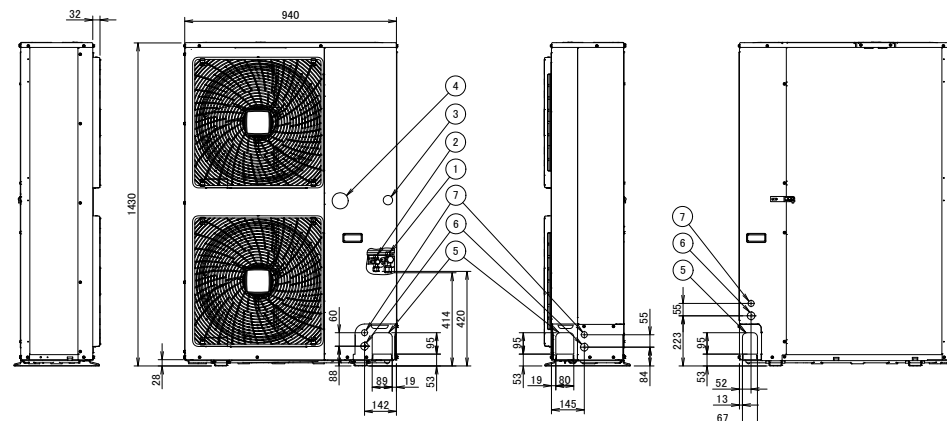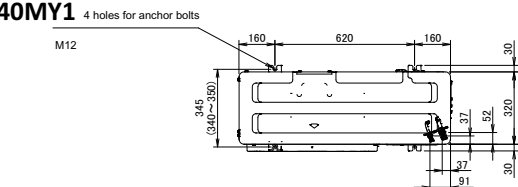

- ① Gas pipe connection Ø15.9 flare
- ② Liquid pipe connection Ø9.5 flare
- ③ Service port (in the unit)
- ④ Electronic connection and grounding terminal M5 (in the switch box)
- ⑤ Refrigerant piping intake
- ⑥ Power supply wiring intake (knockout hole Ø34)
- ⑦ Control wiring intake (knockout hole Ø27)
- ⑧ Drain outlet

3D110012

8 Centre of gravity

8 - 1 Centre of Gravity

8

AZAS100-140MV1


AZAS-MY1

RZAG71MV1

RZAG71MY1

RZASG100-140MV1

RZASG-MY1

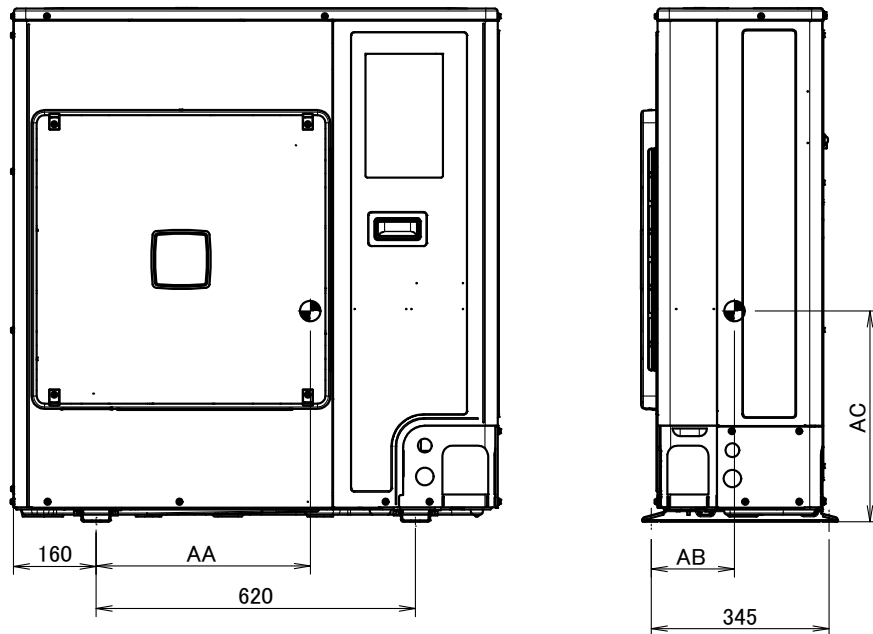

| Model | AA | AB | AC |
|------------------------------------|-----|-----|-----|
| RZAG71M7V* | 414 | 163 | 407 |
| RZAG71M7Y* | 432 | 137 | 407 |
| RZASG100-125M7V* / AZAS100-125M7V* | 425 | 181 | 422 |
| RZASG100-125M7Y* / AZAS100-125M7Y* | 414 | 156 | 417 |
| RZASG140M7V* / AZAS140M7V* | 414 | 161 | 423 |
| RZASG140M7Y* / AZAS140M7Y* | 416 | 151 | 418 |


4D110025

8 Centre of gravity

8 - 1 Centre of Gravity

RZAG100-140MV1

RZAG100-140MY1

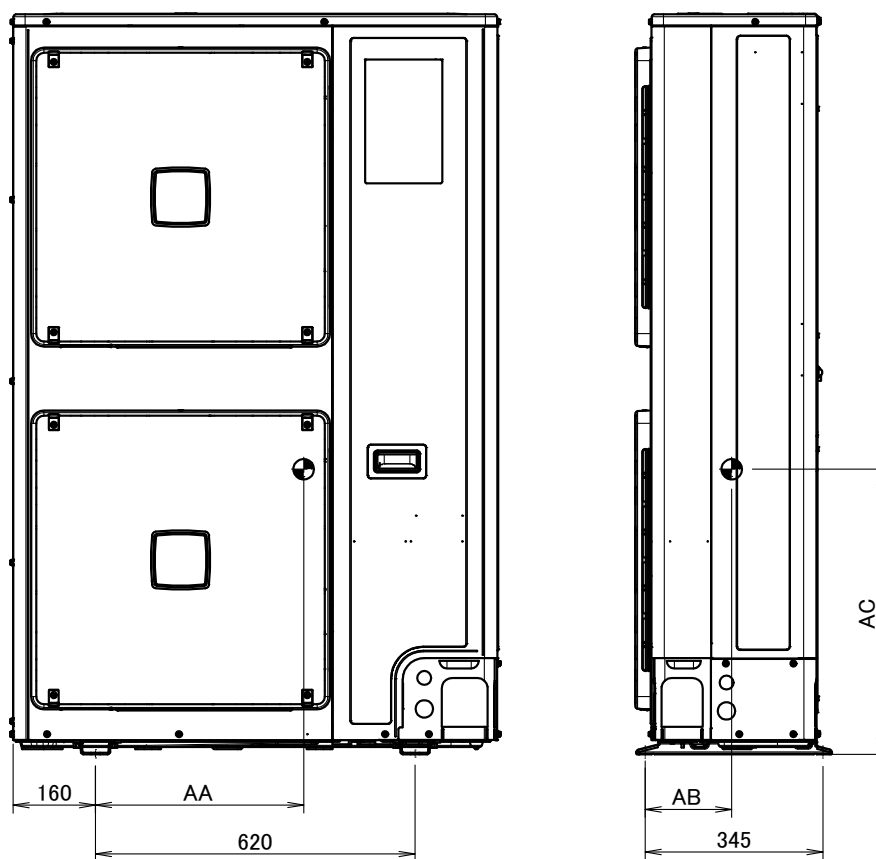

| Model | AA | AB | AC |
|-----------------|-----|-----|-----|
| RZAG100-140M7V* | 403 | 176 | 536 |
| RZAG100-140M7Y* | 396 | 173 | 572 |


4D110026

9 Piping diagrams

9 - 1 Piping Diagrams

9

AZAS-MV1
 AZAS-MY1
 RZAG-MV1
 RZAG-MY1
 RZASG-MV1
 RZASG-MY1

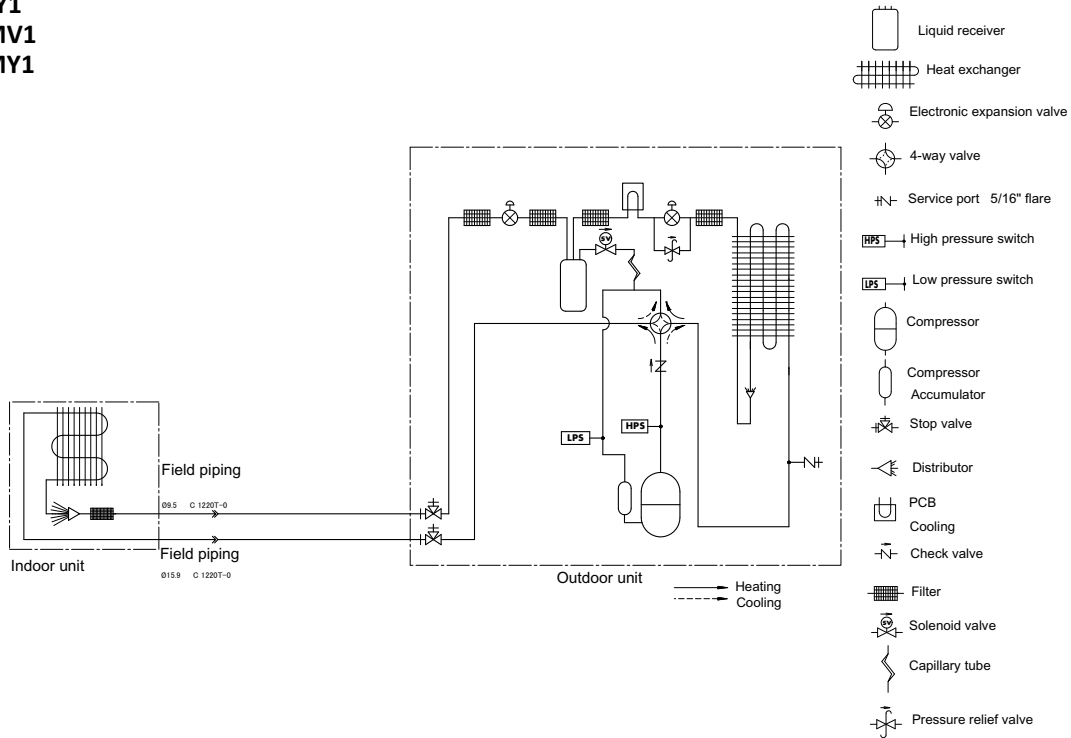


3D108855A

9 Piping diagrams

9 - 2 Piping Diagram Twin Application

RZAG-MV1
RZAG-MY1
RZASG-MV1
RZASG-MY1

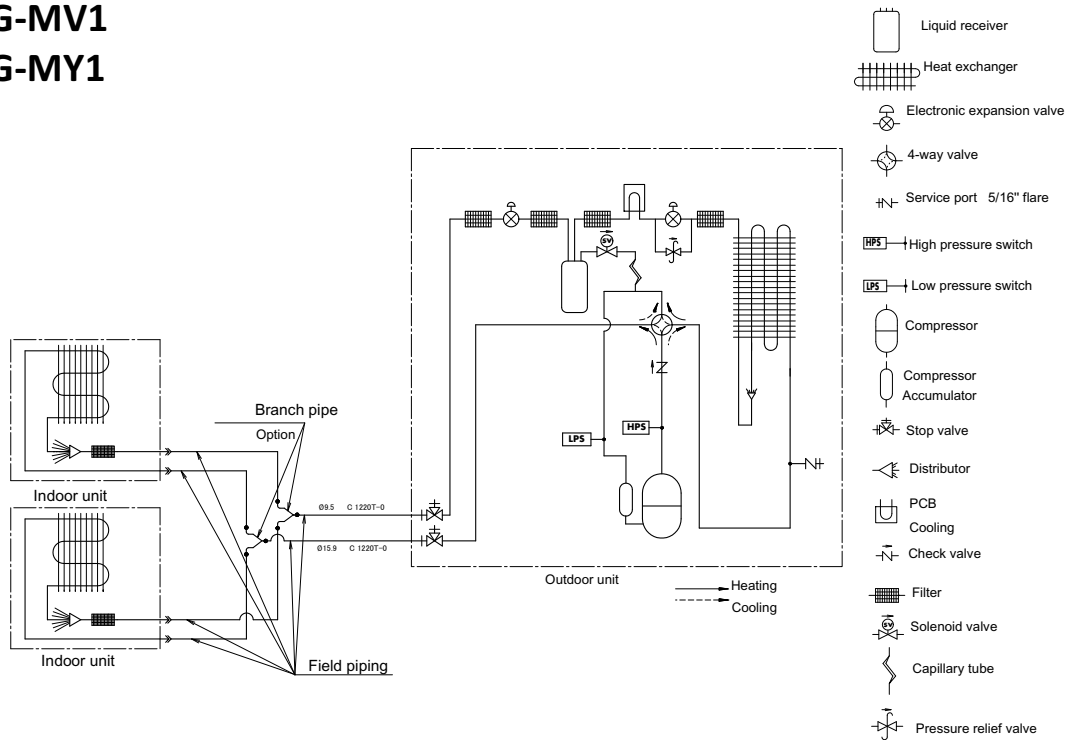

Notes

1. The pipes between the branch and the indoor units should have the same size as the indoor connections.


3D108856A

9 Piping diagrams

9 - 3 Piping Diagram Triple Application

9

RZAG100-140MV1
RZAG100-140MY1
RZASG100-140MV1
RZASG-MY1

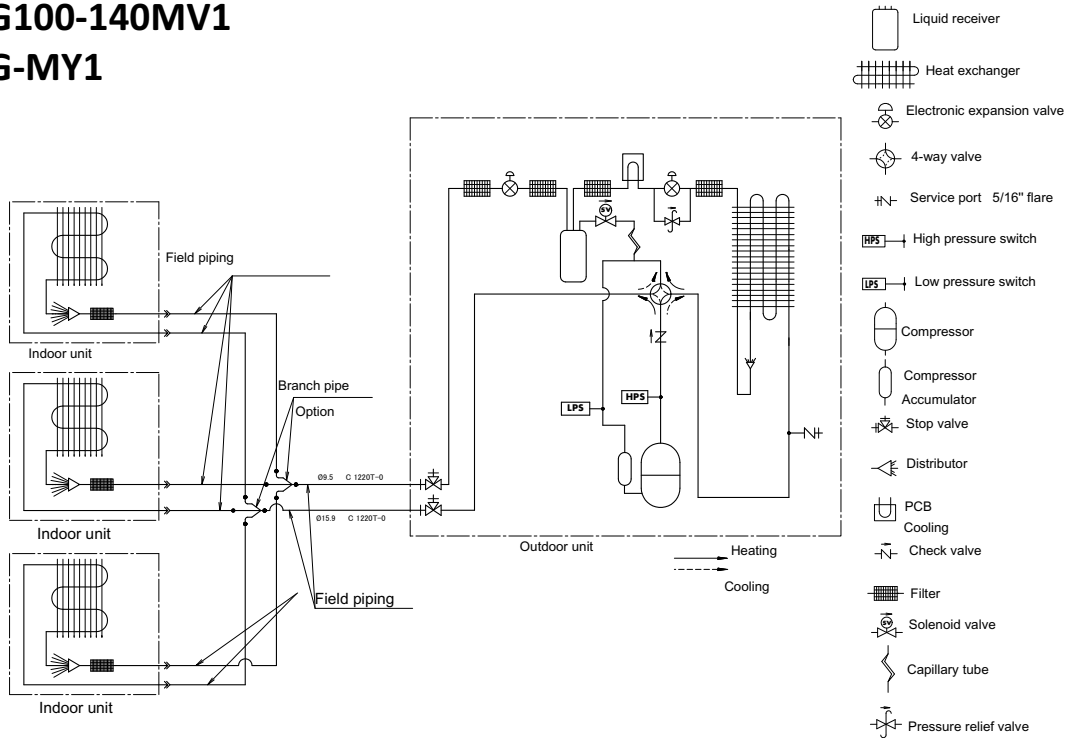


Notes
 1. The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D108857A

9 Piping diagrams

9 - 4 Piping Diagram Double Twin Application

RZAG125-140MV1
 RZAG125-140MY1
 RZASG125-140MV1
 RZASG125-140MY1

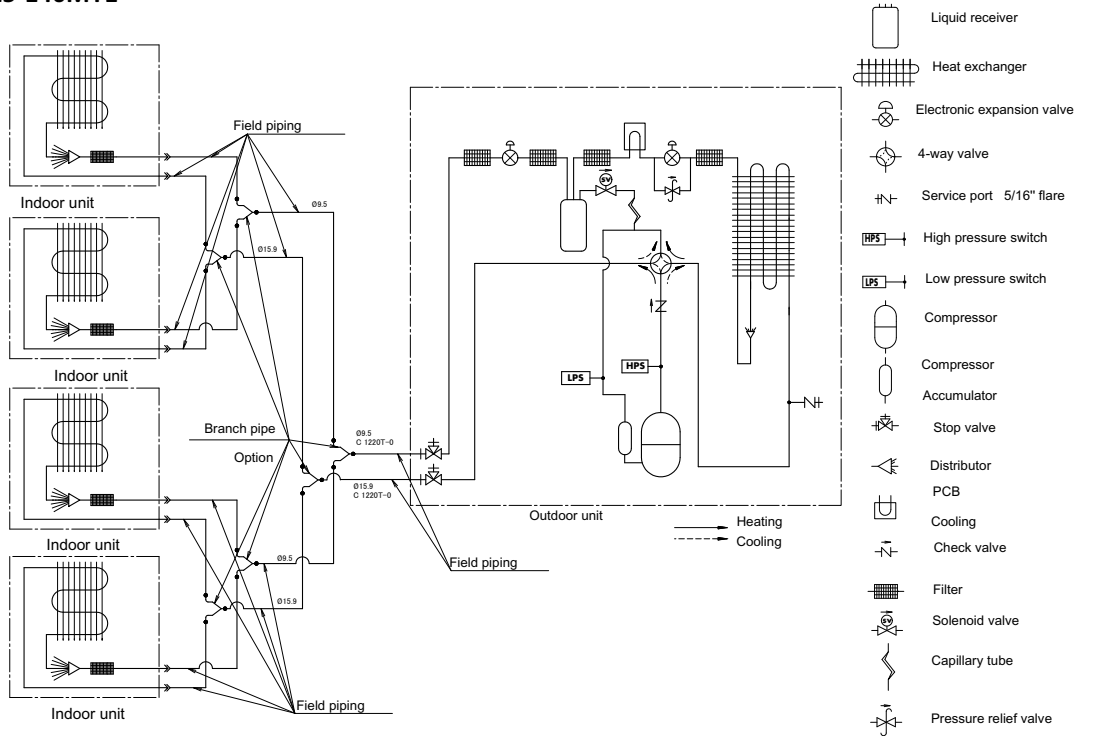

Notes


¹ The pipes between the branch and the indoor units should have the same size as the indoor connections.

3D108858A

11 Sound data

11 - 1 Sound Power Spectrum

RZAG71MV1

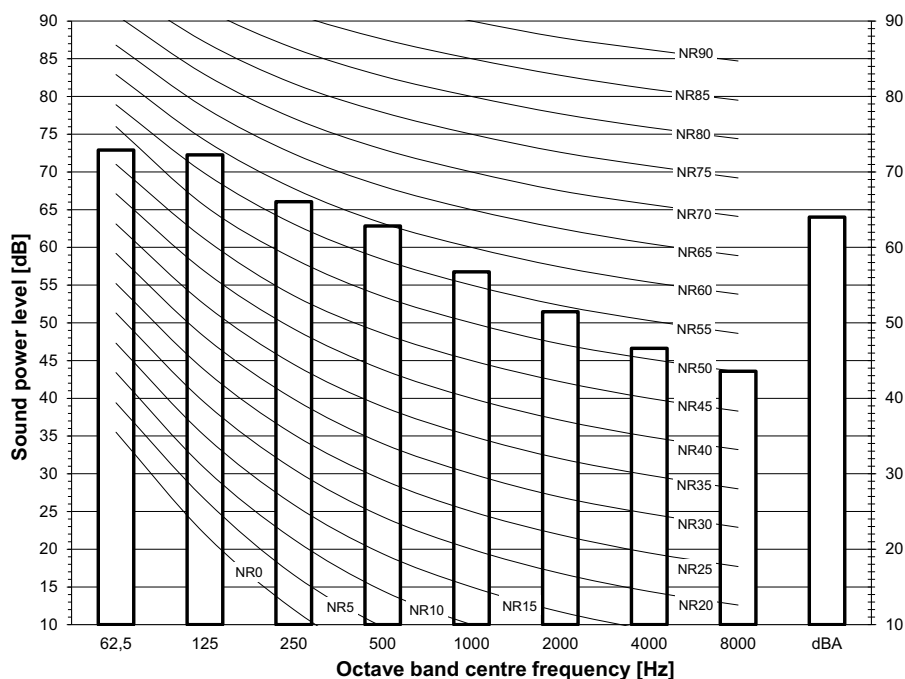


Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = 10E-6μW/m²
- Measured according to ISO 3744

3D110029

RZAG100MV1

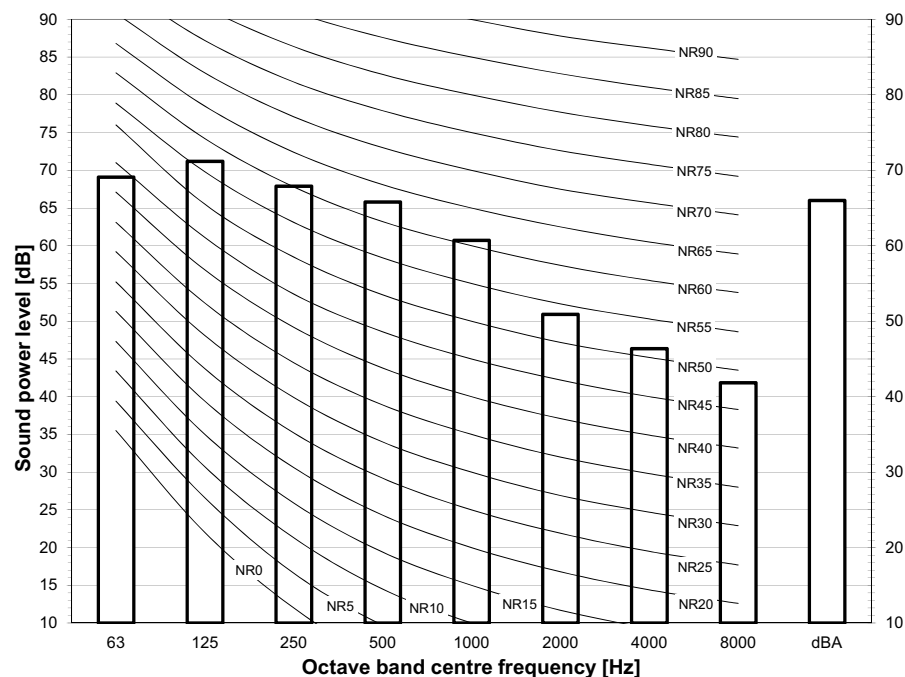

Notes

- dBA = A-weighted sound power level (A scale according to IEC).
- Reference acoustic intensity 0dB = 10E-6μW/m²
- Measured according to ISO 3744


3D110030

11 Sound data

11 - 1 Sound Power Spectrum

11


RZAG125MV1

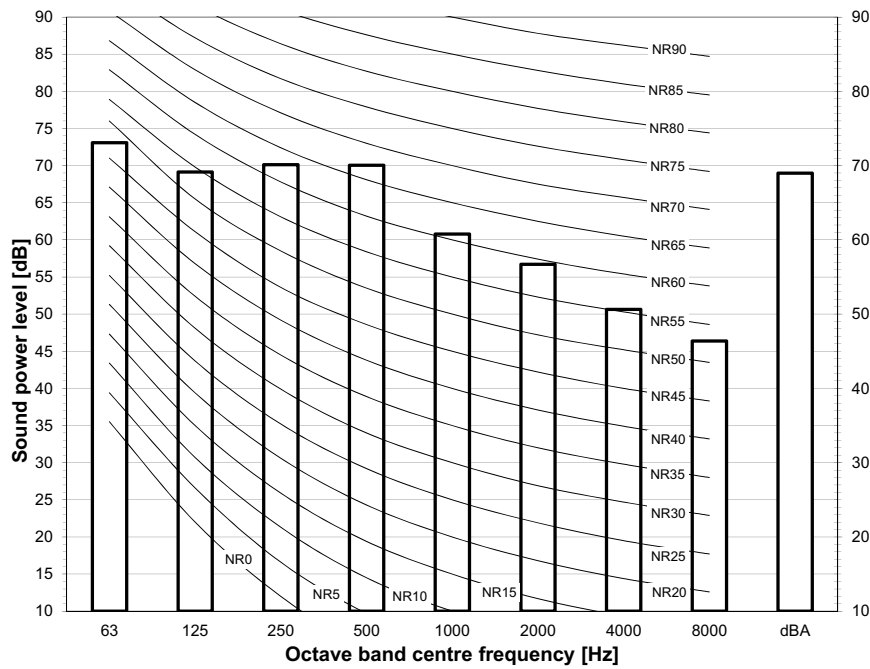

Notes
 - dBA = A-weighted sound power level (A scale according to IEC).
 - Reference acoustic intensity 0dB = 10E-6μW/m²
 - Measured according to ISO 3744

3D110031

RZAG140MV1

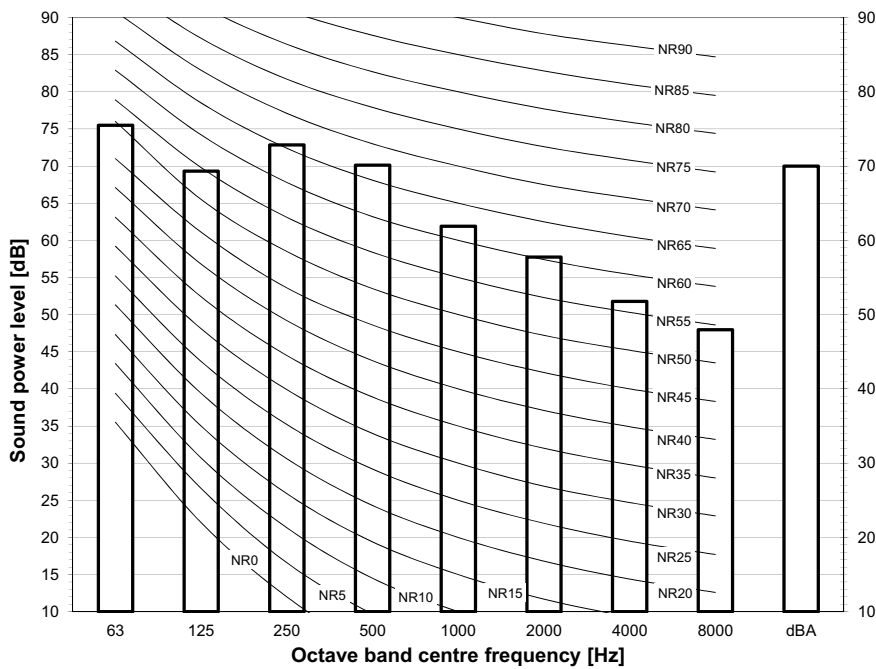


Notes
 - dBA = A-weighted sound power level (A scale according to IEC).
 - Reference acoustic intensity 0dB = 10E-6μW/m²
 - Measured according to ISO 3744

3D110032

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling

RZAG71MV1

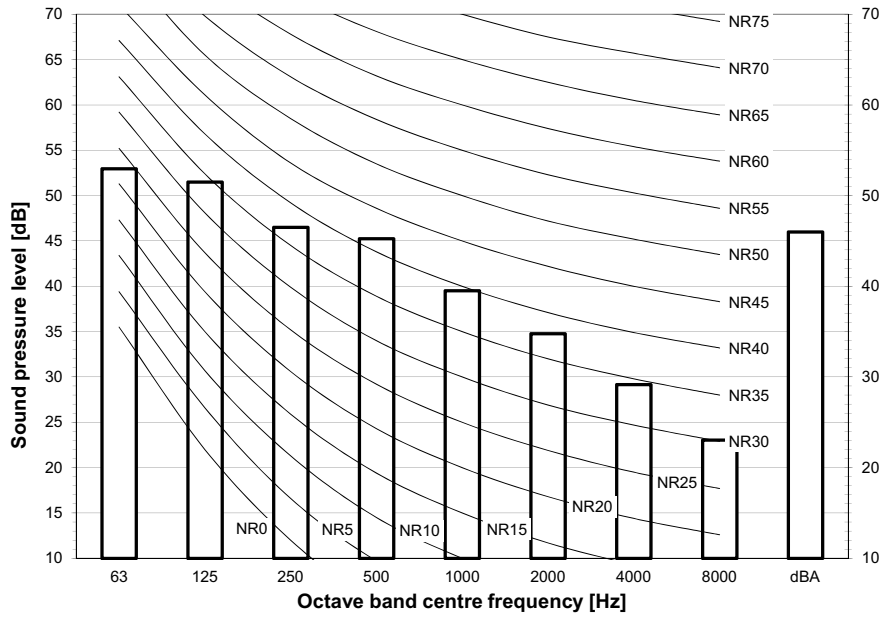


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa

3D110041

RZAG100MV1

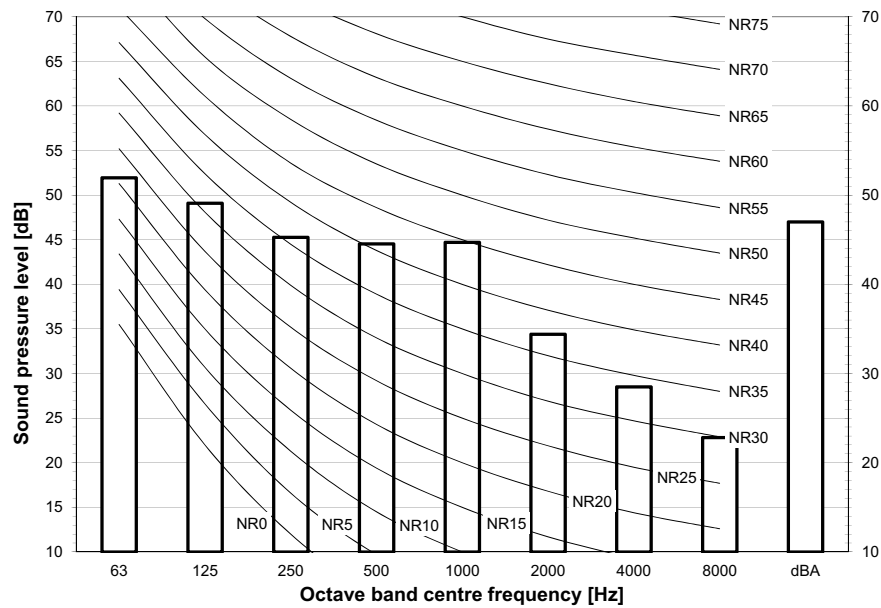

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 μPa


3D110042

11 Sound data

11 - 2 Sound Pressure Spectrum - Cooling

11


RZAG125MV1

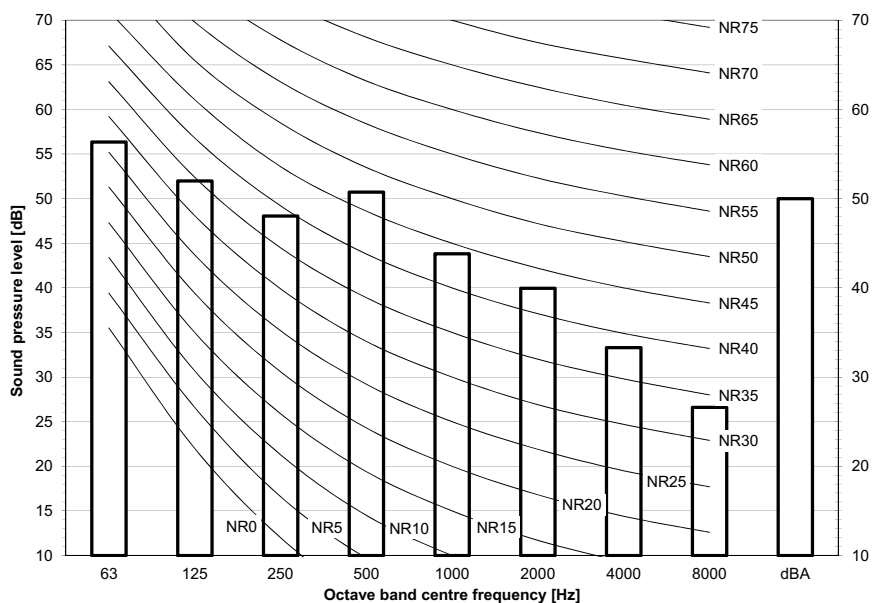

- Notes**
- Data is valid at free field condition.
 - Data is valid at nominal operation condition.
 - dBA = A-weighted sound pressure level (A scale according to IEC).
 - Reference acoustic pressure 0 dB = 20 μ Pa

3D110043

RZAG140MV1

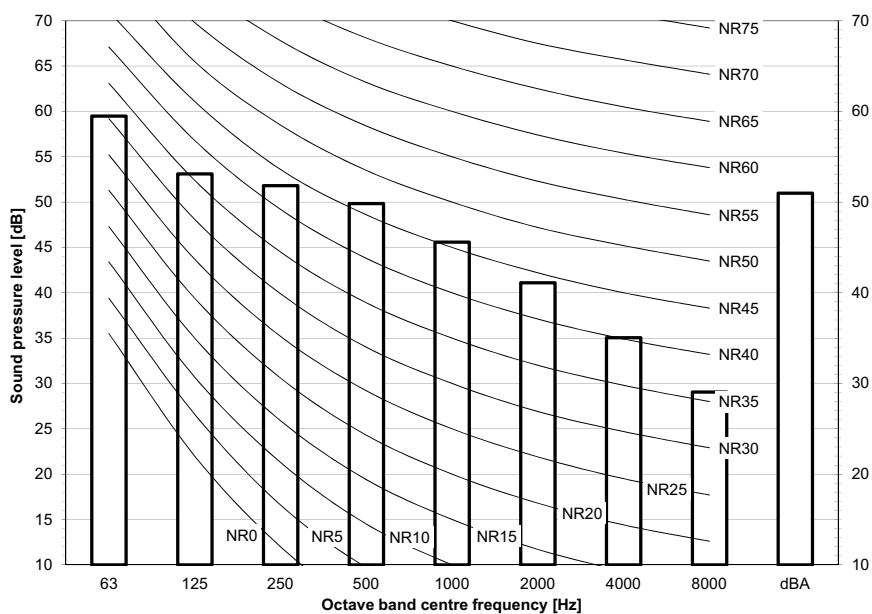


- Notes**
- Data is valid at free field condition.
 - Data is valid at nominal operation condition.
 - dBA = A-weighted sound pressure level (A scale according to IEC).
 - Reference acoustic pressure 0 dB = 20 μ Pa

3D110044

11 Sound data

11 - 3 Sound Pressure Spectrum - Heating

RZAG71MV1

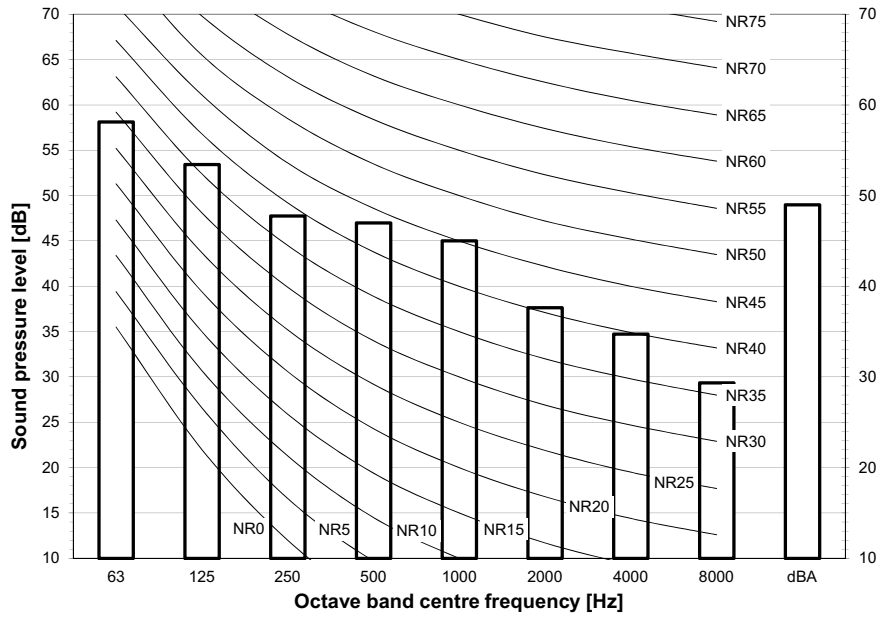


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D111285

RZAG100MV1

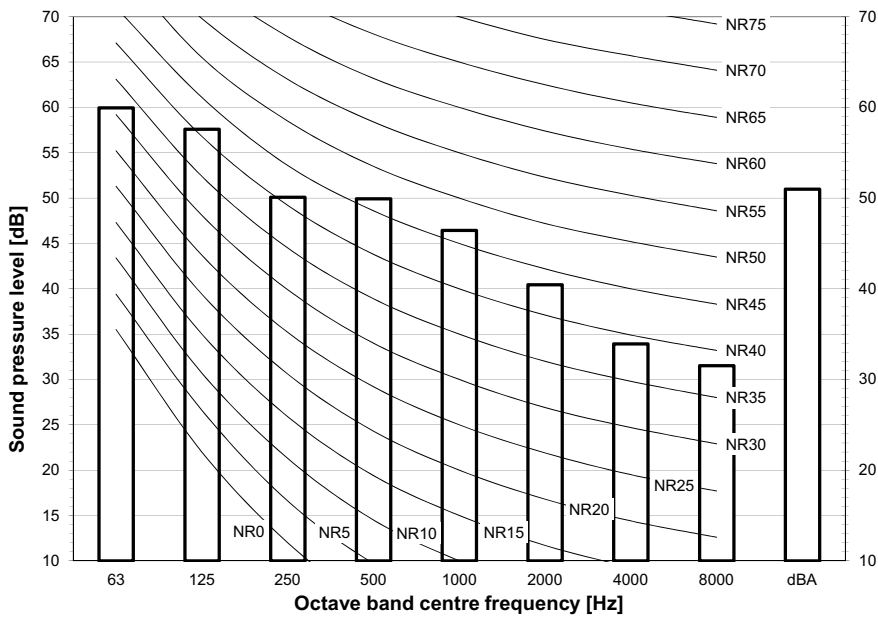

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa


3D111286

11 Sound data

11 - 3 Sound Pressure Spectrum - Heating

11

RZAG125MV1

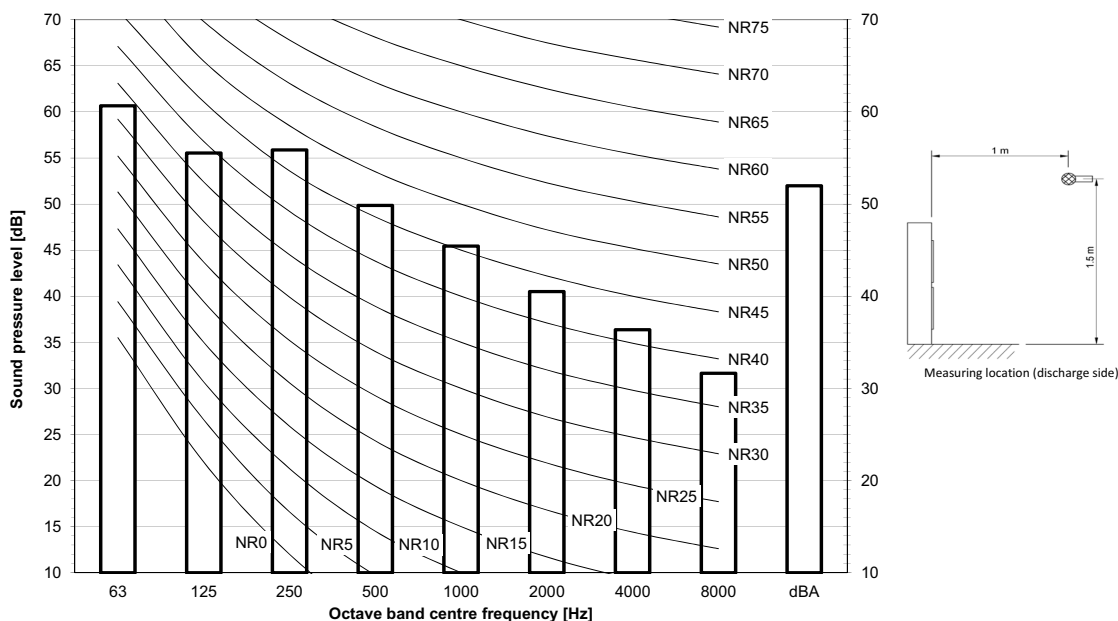


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D111287

RZAG140MV1

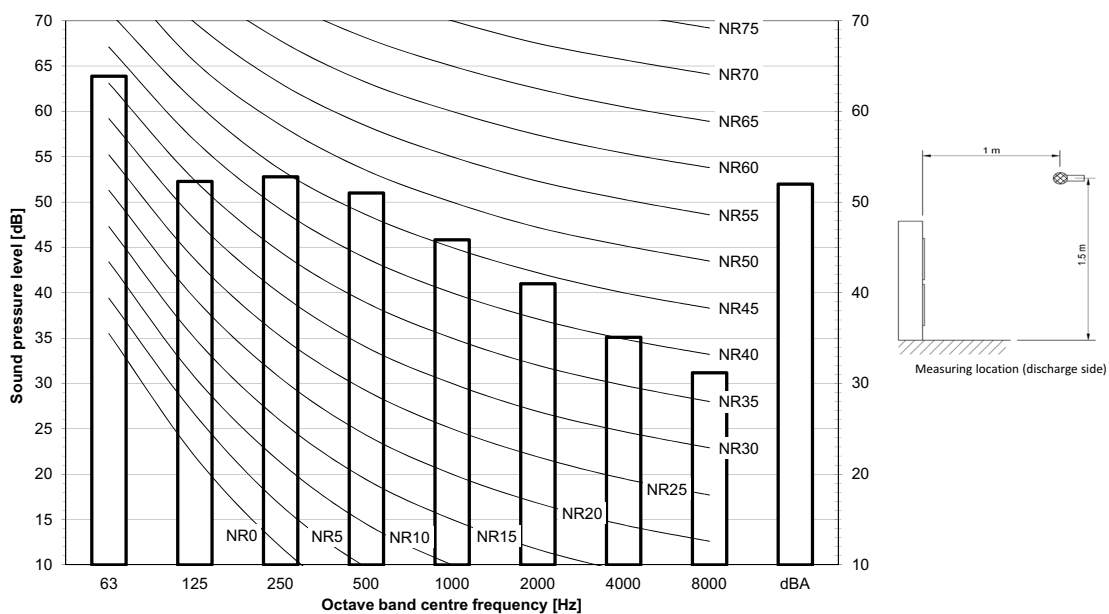

Notes


- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D111288

11 Sound data

11 - 4 Sound Pressure Spectrum Quiet Mode

RZAG71MV1

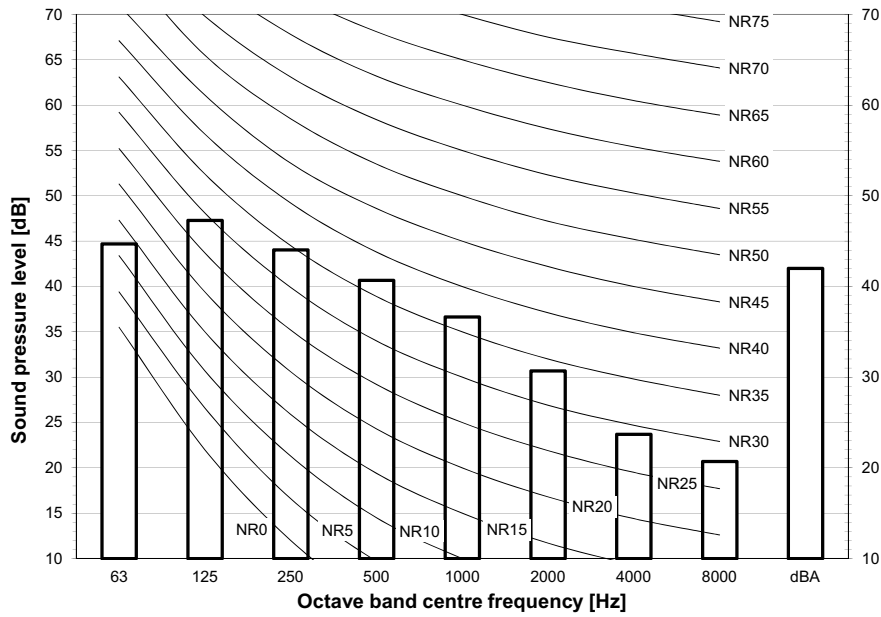


Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D111311

RZAG100-140MV1

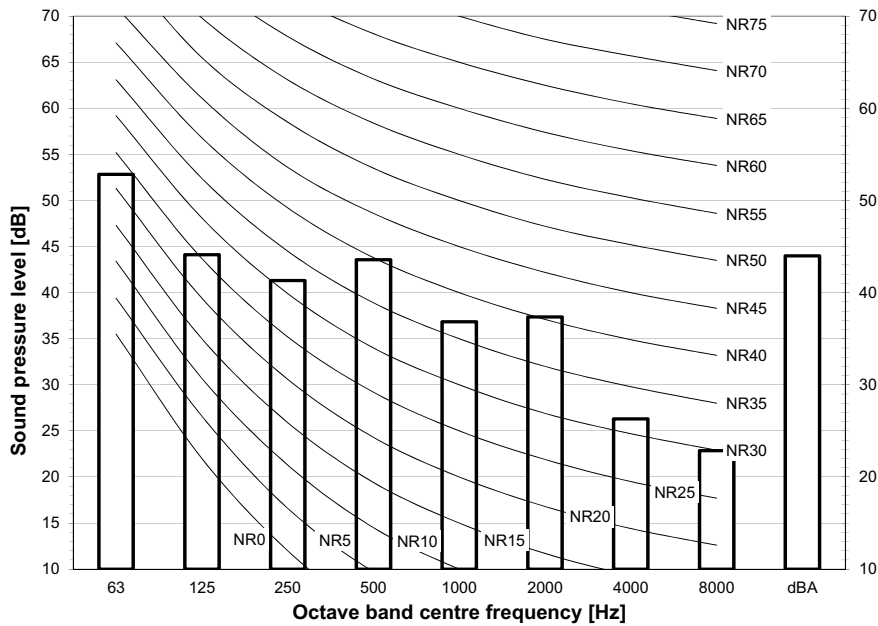

Notes

- Data is valid at free field condition.
- Data is valid at nominal operation condition.
- dBA = A-weighted sound pressure level (A scale according to IEC).
- Reference acoustic pressure 0 dB = 20 µPa

3D111312

12 Installation

12 - 1 Installation Method

RZAG-MV1
 RZAG-MY1
 RZASG-MV1
 RZASG-MY1
 AZAS-MV1
 AZAS-MY1


Installation service space

The measure of these values is "mm".


(A) When there are obstacles on suction sides.

• No obstacle above


- ① Stand-alone installation
 - Obstacle on the suction side only



- Obstacle on both sides and suction side, too




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the suction side and both sides

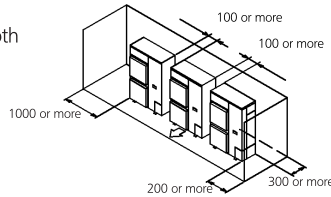


• Obstacle above, too.


- ① Stand-alone installation
 - Obstacle on the suction side, too



- Obstacle on both sides and suction side, too




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the suction side and both sides

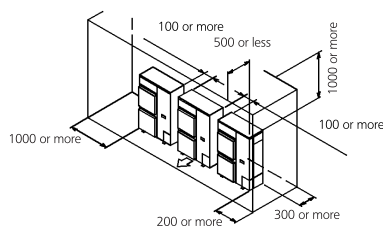


(B) When there are obstacles on discharge sides.

• No obstacle above

- ① Stand-alone installation
 - Obstacle on the discharge side only




- ② Series installation (2 or more) (Note 1)
 - Obstacle on the discharge side only

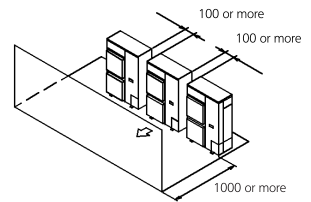


• Obstacle above, too

- ① Stand-alone installation
 - Obstacle on the discharge side only, too



- ② Series installation (2 or more) (Note 1)
 - Obstacle on the discharge side

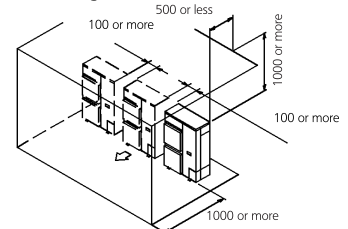


(C) When there are obstacles on both suction and discharge sides.

Pattern 1


When the obstacles on the discharge side is higher than the unit. (L>H)
 (There is no limit for the height of obstructions on the suction side.)

• No obstacle above

- ① Stand-alone installation
 - No obstacle above



- ② Series installation (2 or more) (Note 1)
 - No obstacle above

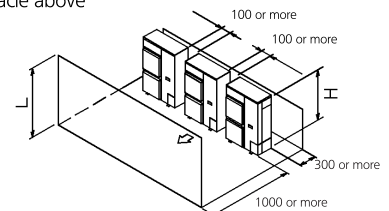

12 Installation

12 - 1 Installation Method


RZAG-MV1
 RZAG-MY1
 RZASG-MV1
 RZASG-MY1
 AZAS-MV1
 AZAS-MY1

• Obstacle above, too

- ① Stand-alone installation (Note 2)
 - When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

| | L | A |
|------------|--|-----------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 750 or more 1000 or more |
| $L > H$ | Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A | |



- ② Series installation (2 or more) (Note 1, 2)
 - When there are obstacles on suction, discharge and top sides.


The relations between H, A and L are as follows.

| | L | A |
|------------|--|------------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 1000 or more 1250 or more |
| $L > H$ | Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A | |

Limit of series installation is 2 units.


Pattern 2

When the obstacle on the discharge side is lower than the unit ($L \leq H$) (There is no limit for the height of obstructions on the suction side.)



• No obstacle above


- ① Stand-alone installation
 - No obstacle above



- ② Series installation (2 or more) (Note 1, 2)
 - When there are obstacles on both suction and discharge sides.

The relations between H, A and L are as follows.

| | L | A |
|------------|--------------------------------------|----------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 250 or more 300 or more |




• obstacle above

- ① Stand-alone installation (Note 2)
 - When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.

| | L | A |
|------------|--|----------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 100 or more 200 or more |
| $L > H$ | Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A | |




- ② Series installation (2 or more) (Note 1, 2)
 - When there are obstacles on suction, discharge and top sides.

The relations between H, A and L are as follows.



| | L | A |
|------------|--|----------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 250 or more 300 or more |
| $L > H$ | Set the stand as : $L \leq H$ Refer to the column of $L \leq H$ for A | |

Limit of series installation is 2 units.




(D) Double-decker installation

- ① Obstacle on the discharge side. (1)
 - Do not exceed two levels for stacked installation.
 - Install a roof cover similar to A (field supply), as outdoor units with downward drainage are prone to dripping and freezing.
 - Install the upper-level outdoor unit so that its bottom plate is a sufficient height above the roof cover. This is to prevent the buildup of ice on the underside of the bottom plate.
- ② Obstacle on the suction side. (1)
 - Do not exceed two levels for stacked installation.
 - Install a roof cover similar to A (field supply), as outdoor units with downward drainage are prone to dripping and freezing.
 - Install the upper-level outdoor unit so that its bottom plate is a sufficient height above the roof cover. This is to prevent the buildup of ice on the underside of the bottom plate.



(E) Multiple rows of series installation (on the rooftop, etc.)


- ① One row of stand-alone installation

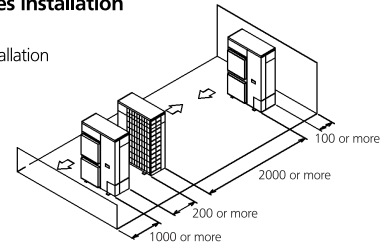

- ② Rows of series installation (2 or more)

The relations between H, A and L are as follows.

| | L | A |
|------------|--------------------------------------|----------------------------|
| $L \leq H$ | $L \leq 1/2 H$ $1/2 H < L \leq H$ | 250 or more 300 or more |
| $L > H$ | Can not be installed | |

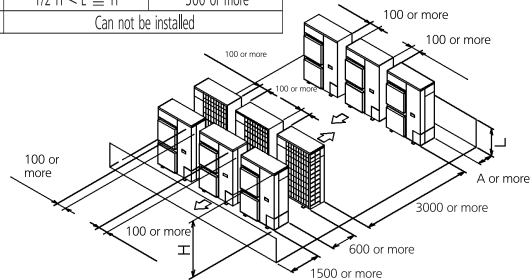

NOTES

- In case of the sideways piping, make a 100mm gap between the unit above.
- Close the bottom of the installation frame to prevent the discharged air from being bypassed.
- It is not necessary to install a roof cover if there is no danger of drainage dripping and freezing. In this case, the space between the upper and lower outdoor units should be at least 100mm. Close off the gap between the upper and lower units so there is no re-intake of discharged air.


13 Operation range

13 - 1 Operation Range

13


RZAG-MV1 RZAG-MY1

Cooling

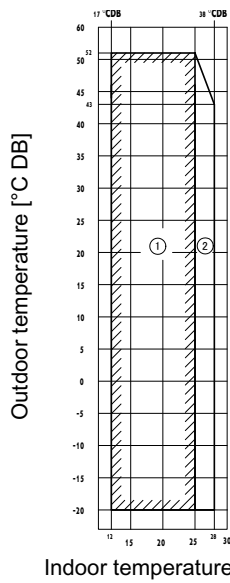

- ① Operation range
- ② Pull-down operation range
- ③ Warm-up operation range

Heating

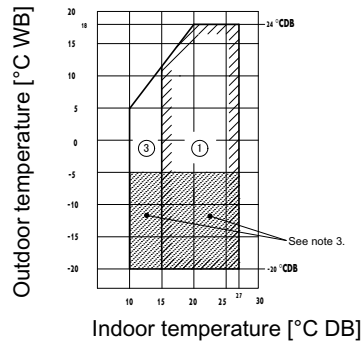


Notes

1. Depending on operation and installation conditions, the indoor unit can change over to freeze-up operation (indoor de-icing).
2. To reduce the freeze-up operation (indoor de-icing) frequency, it is recommended to install the outdoor unit in a location not exposed to wind.
3. If the unit is selected to operate at ambient temperature < -5°C for 5 days or more, with relative humidity of 100%, it is required to install the optional bottom plate heater.

3D110020A



Daikin Europe N.V. Naamloze Vennootschap - Zandvoordestraat 300, B-8400 Oostende - Belgium - www.daikin.eu - BE 0412 120 336 - RPR Oostende



EEDEN17 08/17



Daikin Europe N.V. participates in the Eurovent Certified Performance programme for Liquid Chilling Packages and Hydronic Heat Pumps, Fan Coil Units and Variable Refrigerant Flow systems. Check ongoing validity of certificate: www.eurovent-certification.com



The present leaflet is drawn up by way of information only and does not constitute an offer binding upon Daikin Europe N.V.. Daikin Europe N.V. has compiled the content of this leaflet to the best of its knowledge. No express or implied warranty is given for the completeness, accuracy, reliability or fitness for particular purpose of its content and the products and services presented therein. Specifications are subject to change without prior notice. Daikin Europe N.V. explicitly rejects any liability for any direct or indirect damage, in the broadest sense, arising from or related to the use and/or interpretation of this leaflet. All content is copyrighted by Daikin Europe N.V.